


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, AND NEC GUIDELINES

NOTE:  
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND  
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO  
STARTING WORK

Exhaust Fan, 24" dia  
2 HP, 7983 CFM @ 0.5" SP  
UL APPROVED

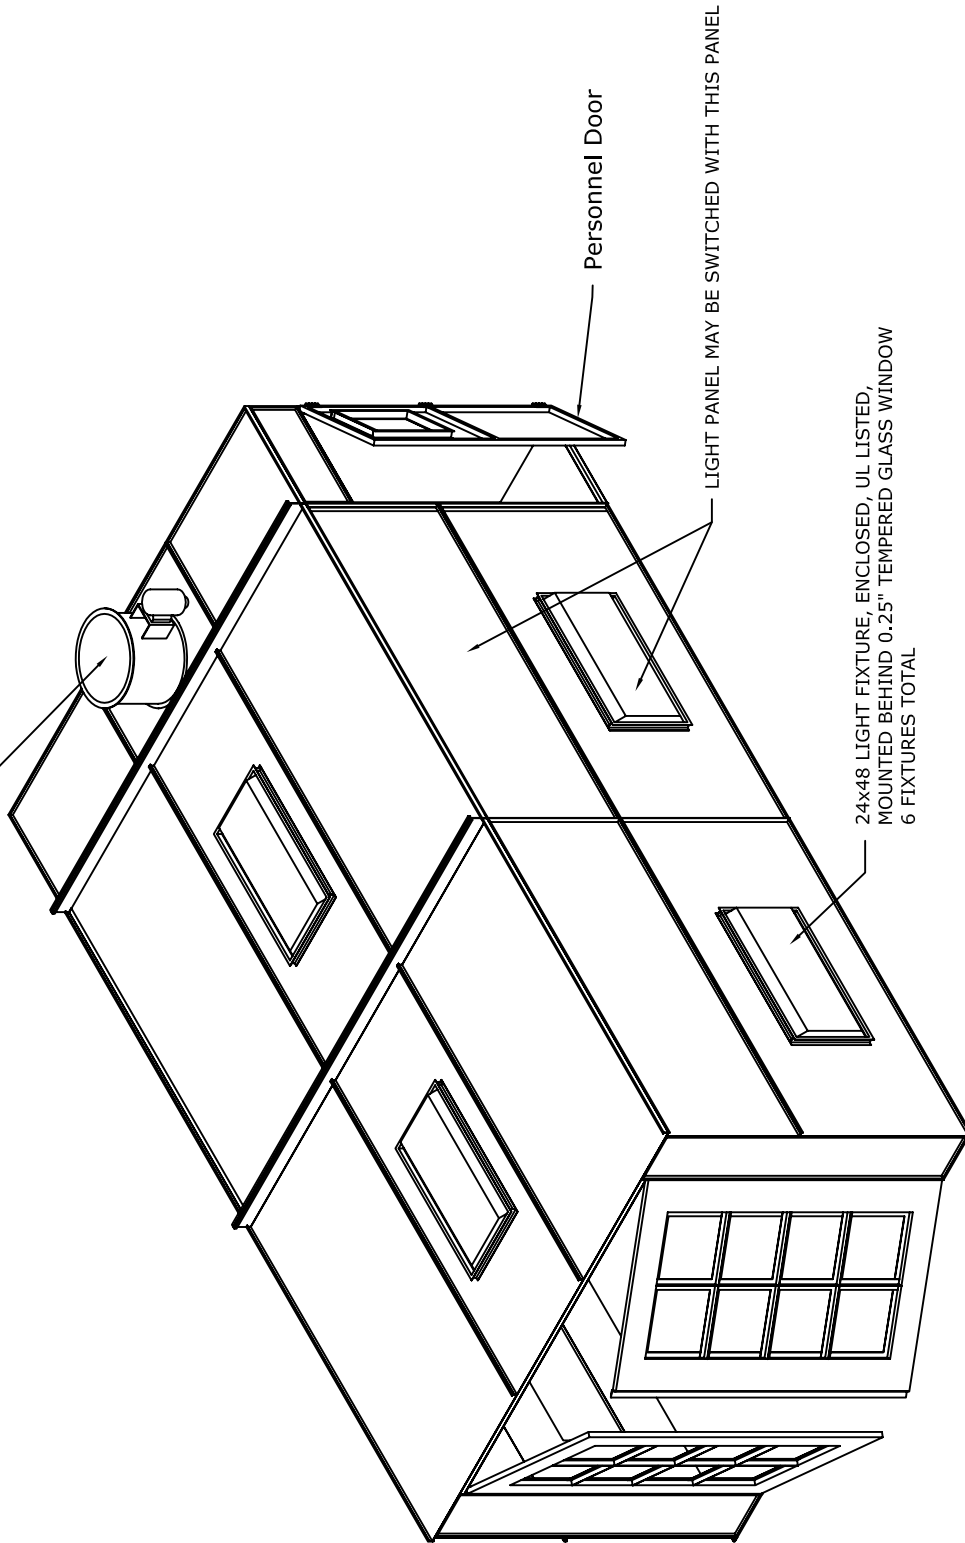

**BARGAIN ECONOMY CROSS FLOW-1000**

13'-0"W x 8'-10"H x 23'-1"L OUTSIDE  
12'-9"W x 8'-4"H x 20'-3"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405  
Ph - 1-800-451-2425

title	BECF-1000 SHEET 1 OF 2
part no	BECF-1000
order no	-
drawn by	BBURLESON
date	2-13-07
file name	XXXX
rev	G