


NOTE;
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
 REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
 STARTING WORK

Exhaust Fan, 24" dia
 2hp, 7800 CFM @ 0.5" SP
 UL APPROVED

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
 AND BOCA GUIDELINES

BARGAIN ECONOMY SEMIDOWN DRAFT

13'-0"W x 10'-7"H x 23'-1"L OUTSIDE
 12'-9"W x 8'-4"H x 20'-0"L INSIDE

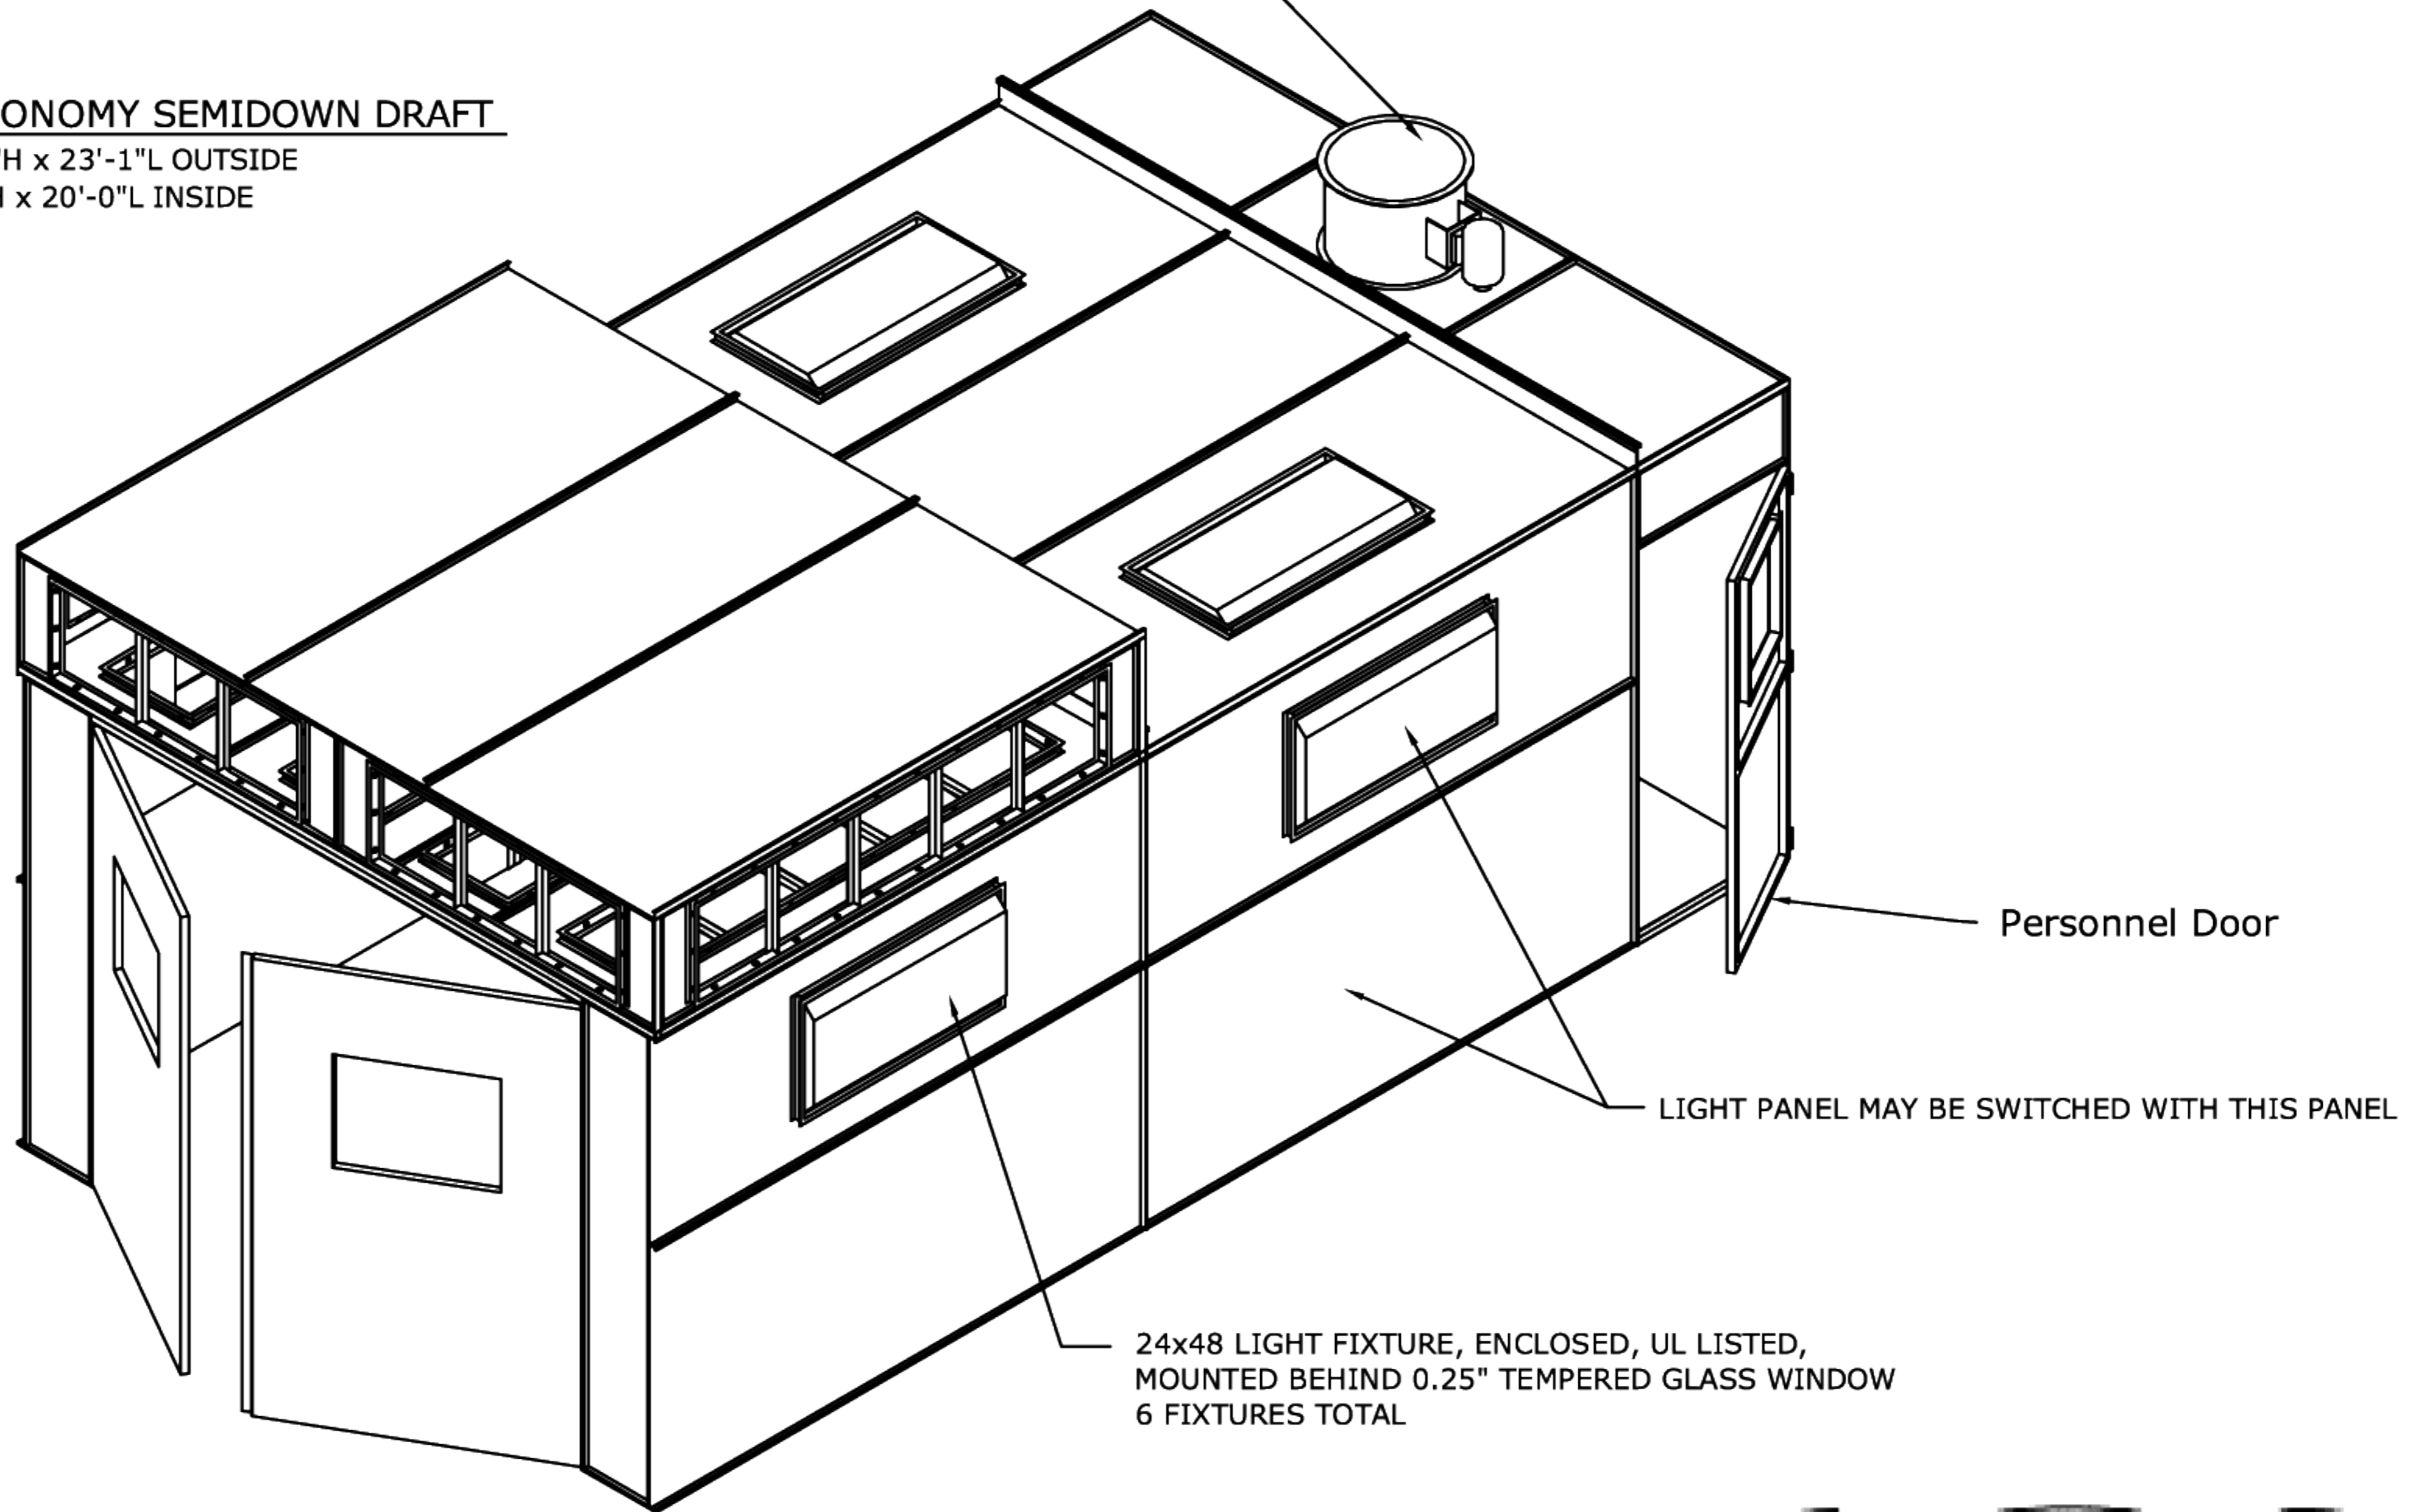

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
 Ph - 1-800-451-2425

title	BESD-1000 SHEET 1 OF 3	
part no	BESD-1000	
order no	-	
drawn by	MBOWLES	date 1-17-05
file name	XXXX	rev A