
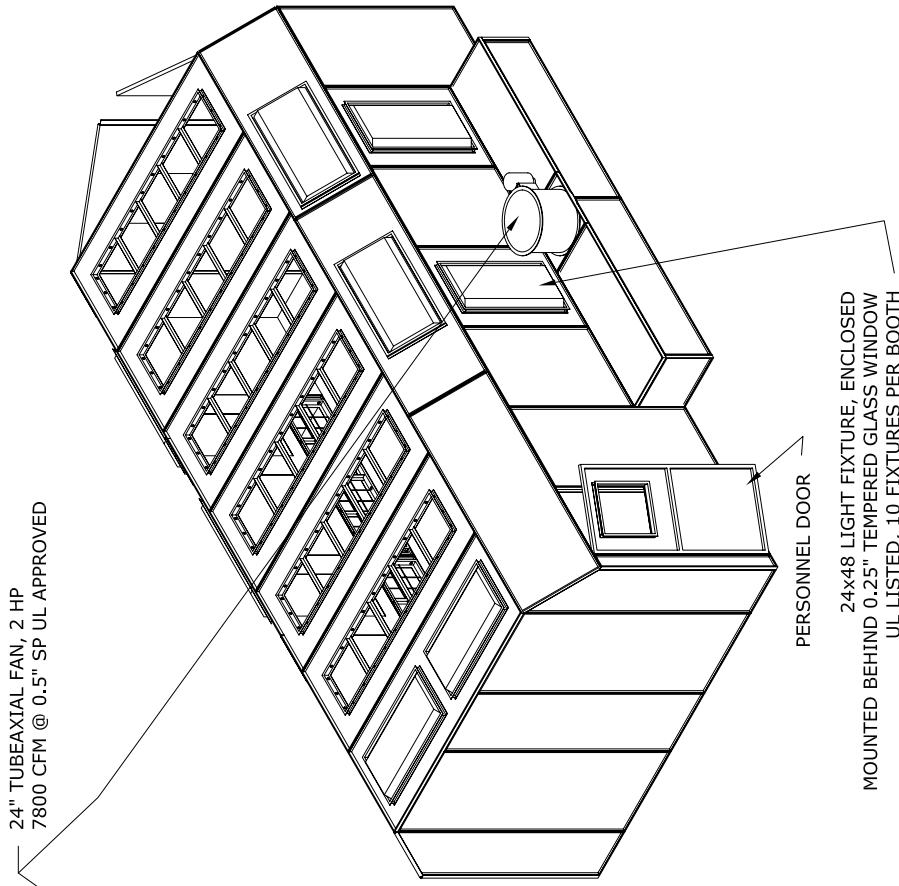


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

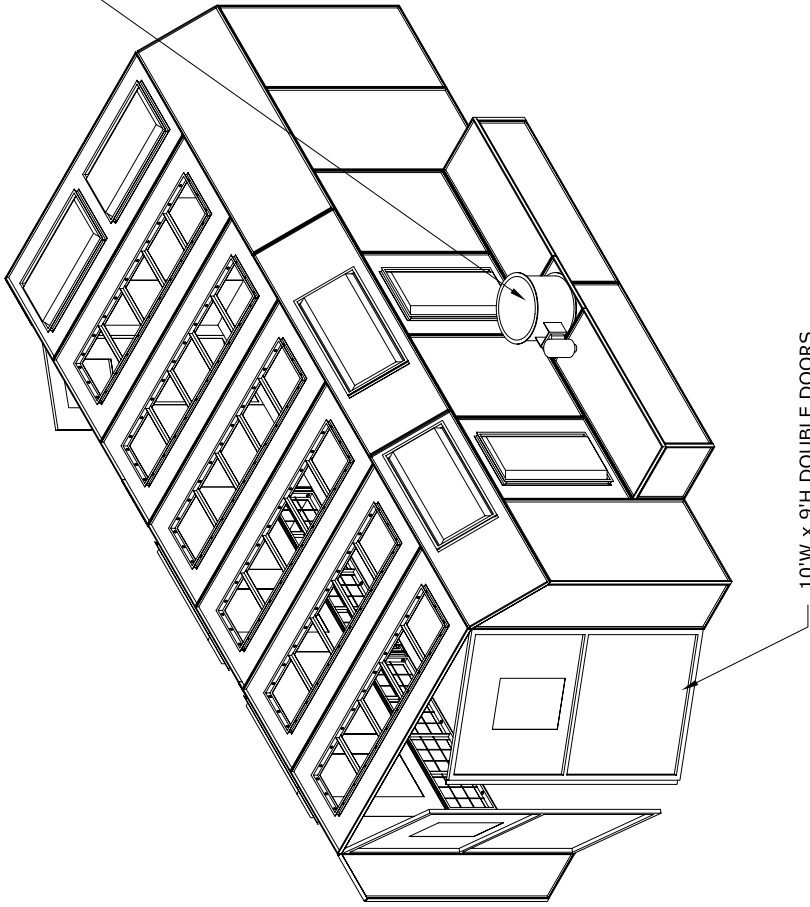

24" TUBEAXIAL FAN, 2 HP
7800 CFM @ 0.5" SP UL APPROVED

ESDD-1000

18'-11"W x 25'-8"L x 1'-3"H OUTSIDE
14' W x 25'-5" L x 9' H INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 3/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
Ph - 1-800-451-2425

title	ESDD-1000 SHEET 1 OF 3
part no	ESDD-1000
order no	-
drawn by	MBOWLES
date	2-28-05
file name	XXXX
rev	A