


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

Exhaust Fan, 24" dia
2 hp, 7800 CFM @ 0.5" SP
UL APPROVED

NOTE:
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
STARTING WORK

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,
MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW
2 FIXTURES TOTAL

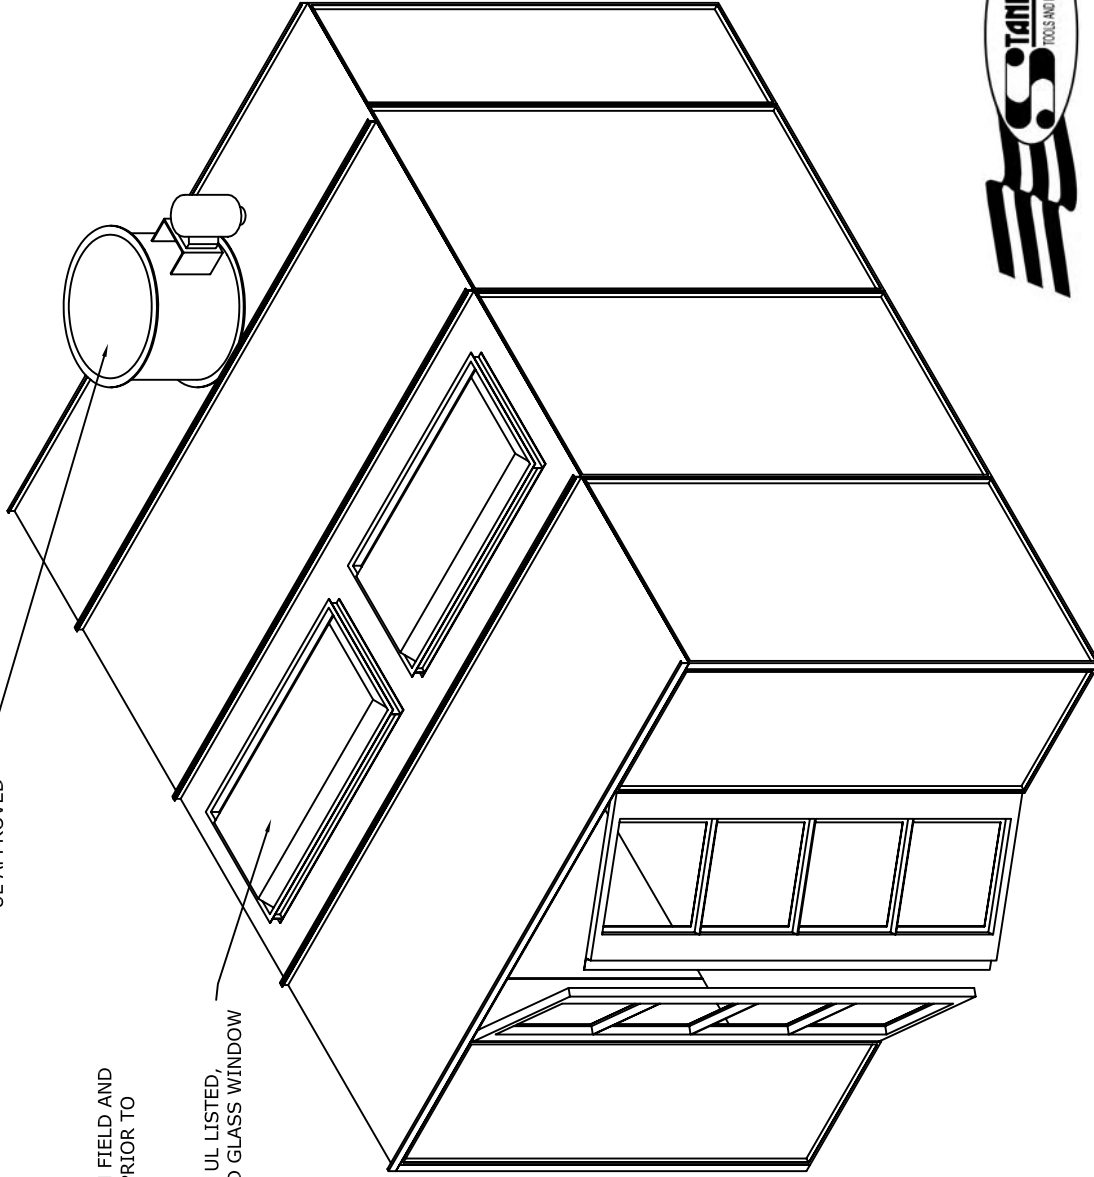

INDUSTRIAL PARTS BOOTH-1000

10'-0"W x 7'-1-1/2"H x 13'-0"L OUTSIDE
9'-9"W x 7'-0"H x 10'-6-1/2"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.

title IPB-1000 SH 1 OF 2

part no IPB-1000

order no -

drawn by

file name XXXX

date 12-23-03

rev B