


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, AND  
NEC GUIDELINES

Exhaust Fan, 30" dia  
3 hp, 12,200 CFM @ 0.5" SP  
UL APPROVED

NOTE:  
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND  
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO  
STARTING WORK

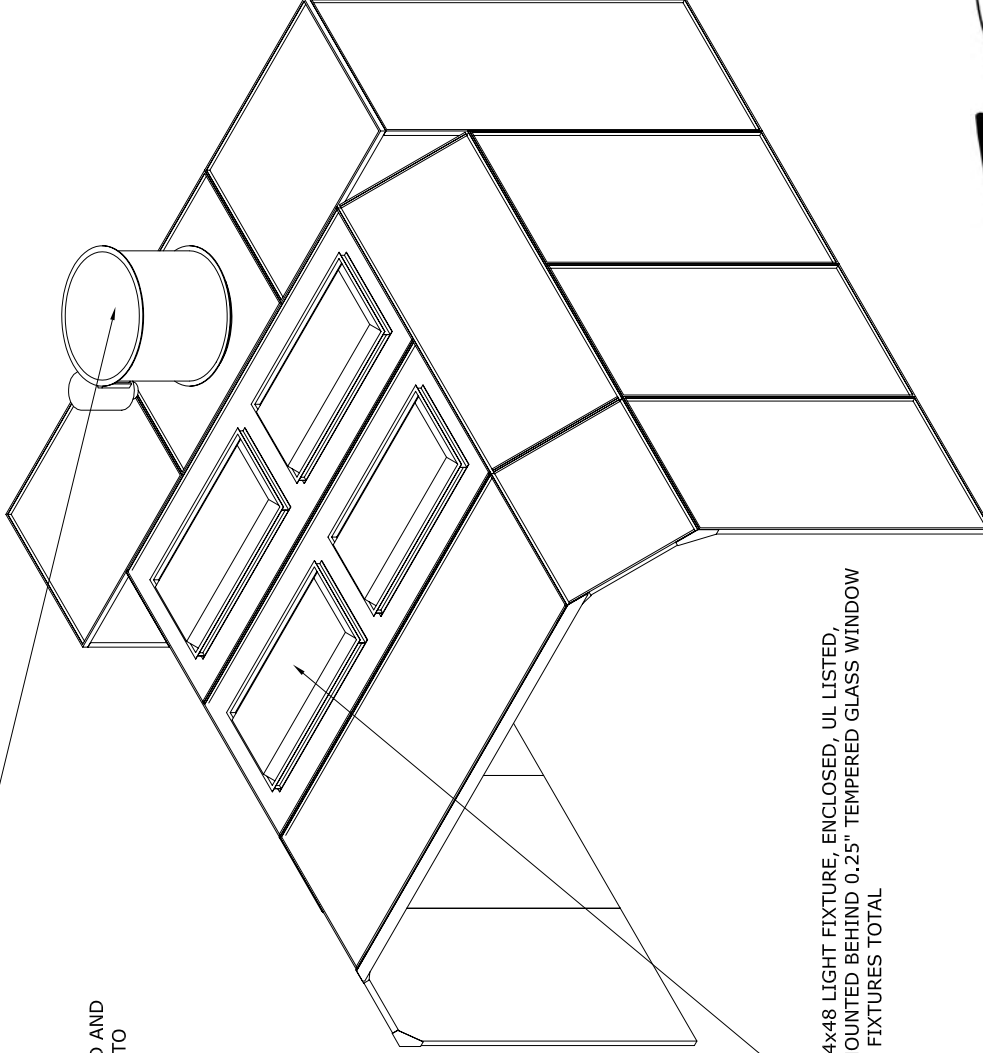

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,  
MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW  
4 FIXTURES TOTAL

**INDUSTRIAL PAINT WALL-1000**

14'-3"W x 9'-1-1/2"H x 14'-8"L OUTSIDE  
14'-0"W x 9'-0"H x 11'-0"L INSIDE

**NOTES:**

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405  
Ph - 1-800-451-2425

title	IPW-1000-148 SH 1 OF 2
part no	IPW-1000-148
order no	-
drawn by	MBOWLES
file name	XXXX
date	9-21-05
rev	C