


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

EXHAUST FAN 30" TUBEAXIAL, 3 HP
12,200 CFM @ 0.5" SP, UL APPROVED

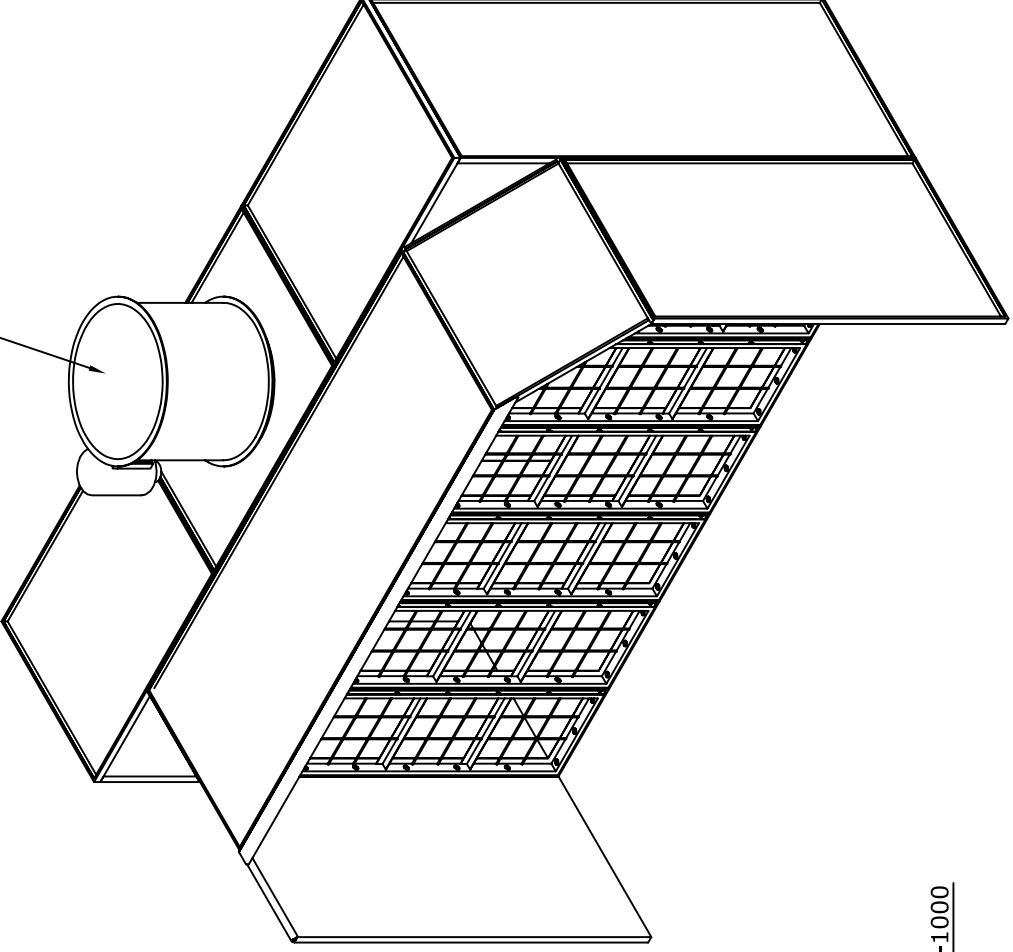

NOTE:
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
STARTING WORK

INDUSTRIAL PAINT WALL IPW-1000

14'-3"W x 9'-1-1/2"H x 7'-4"L OUTSIDE
14'-0"W x 9'-0"H x 3'-8"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
Ph - 1-800-451-2425

title	IPW-1000-74 SHEET 1 OF 2		
part no	IPW-1000		
order no	XXXXXX		
drawn by	M BOWLES	date	10-1-04
file name	XXXX	rev	B