


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

3HP 3PH, 9332 CFM @ 0.5" SP
UL APPROVED
Exhaust Fan, 24" dia

NOTE:
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
STARTING WORK

MOTORCYCLE CROSS FLOW-1000
13'-0"W x 8'-10"H x 13'-1"L OUTSIDE
12'-9"W x 8'-4"H x 9'-10 1/2"L INSIDE

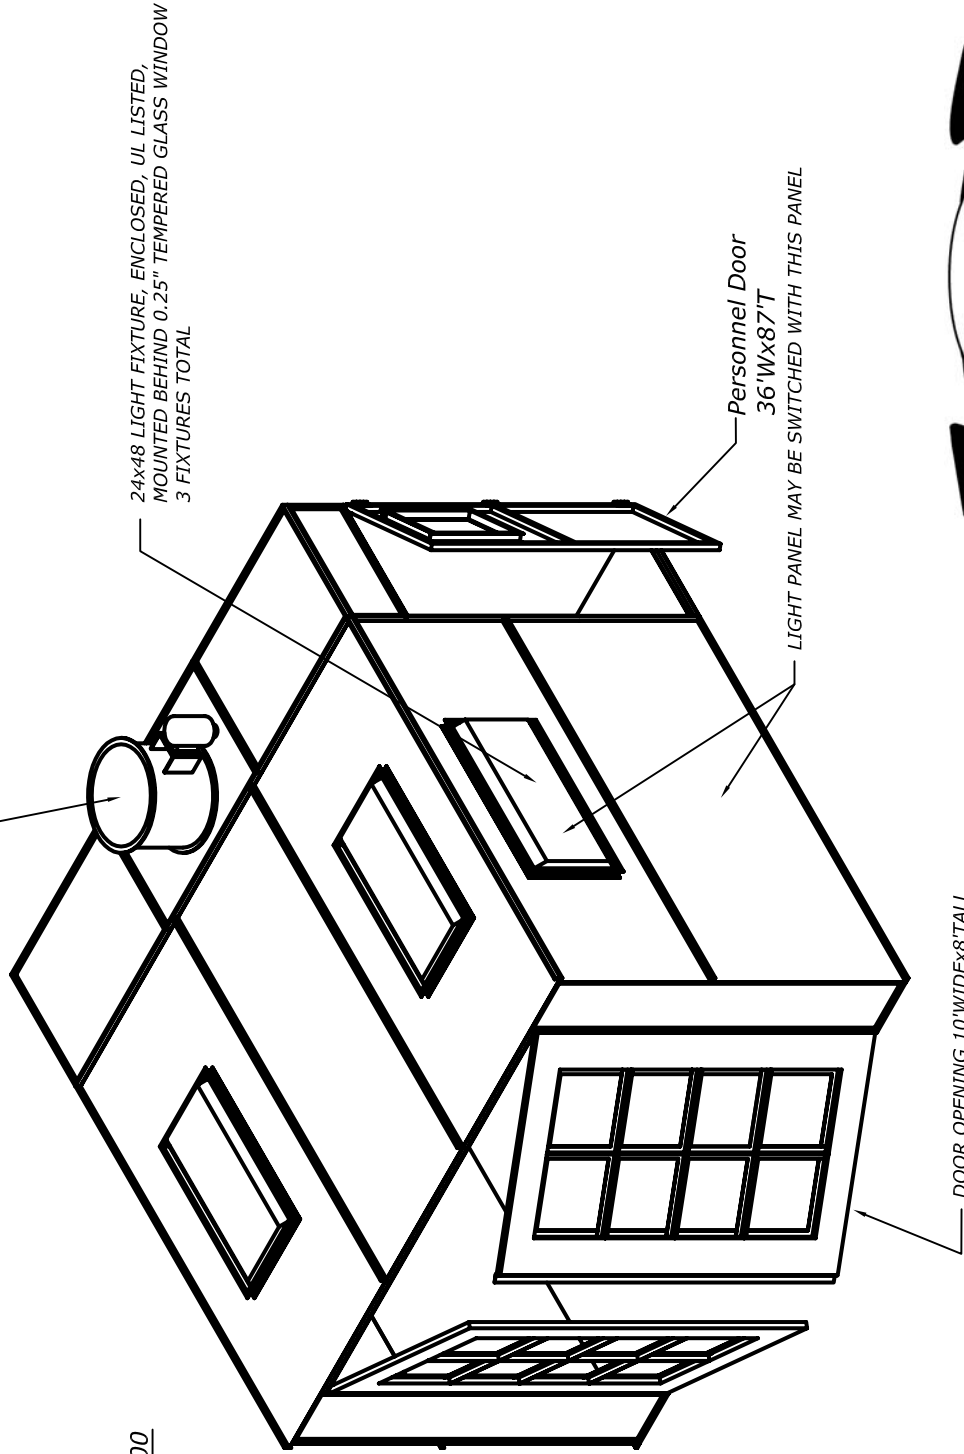

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,
MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW
3 FIXTURES TOTAL

Personnel Door
36'Wx87'T

LIGHT PANEL MAY BE SWITCHED WITH THIS PANEL

DOOR OPENING 10"WIDEx8'TALL



Greensboro, NC 27405
Ph - 1-800-451-2425

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.

title	MCB-1000 SHEET 1 OF 2		
part no	MCB-1000		
order no	-		
drawn by	R.BRIDGES	date	9-3-08
file name	XXXX	rev	A