


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

NOTE:
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
STARTING WORK

EXHAUST FAN, 12" DIA
1/2 HP, 1429 CFM @ 0.5" SP
UL APPROVED

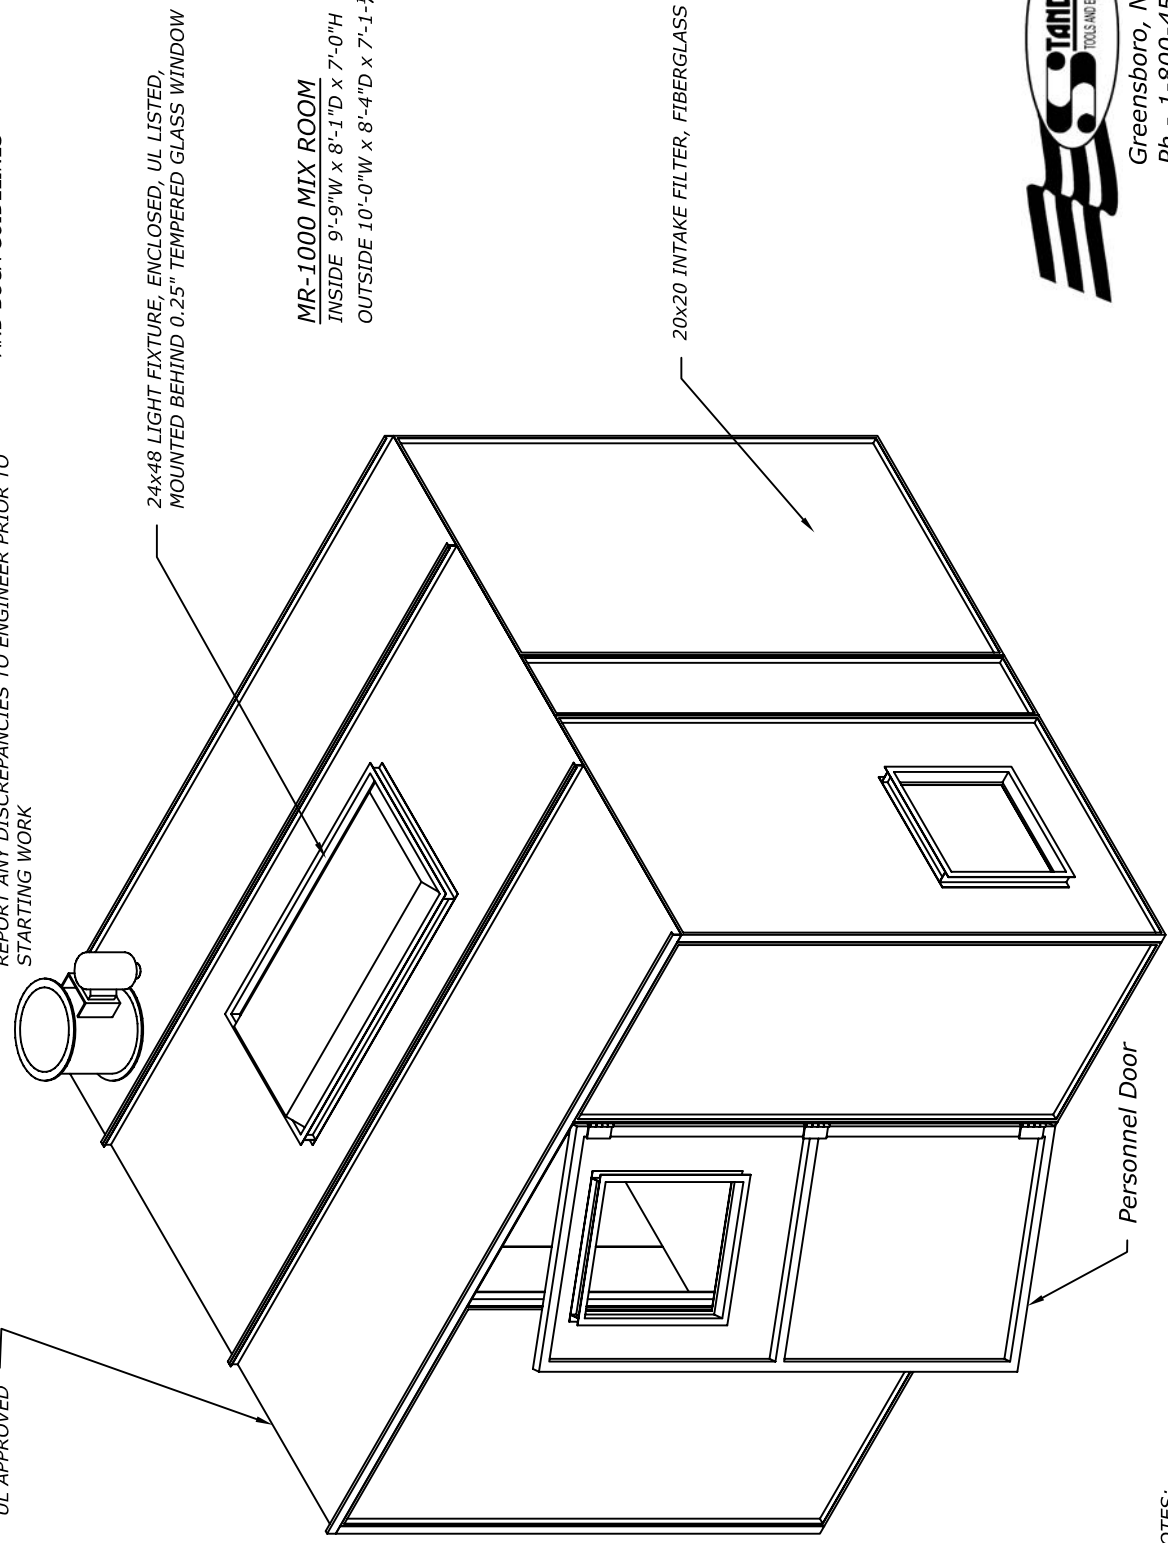

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,
MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW

MR-1000 MIX ROOM
INSIDE 9'-9"W x 8'-1"D x 7'-0"H
OUTSIDE 10'-0"W x 8'-4"D x 7'-1-1/2"H

20x20 INTAKE FILTER, FIBERGLASS

Personnel Door



Greensboro, NC 27405
Ph - 1-800-451-2425

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 3/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.

title	MR-1000 SHEET 1 OF 2		
part no	MR-1000		
order no	-		
drawn by	R.BRIDGES	date	5-22-08
file name	XXXX	rev	C