


NOTE:
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
 REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
 STARTING WORK

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
 AND BOCA GUIDELINES

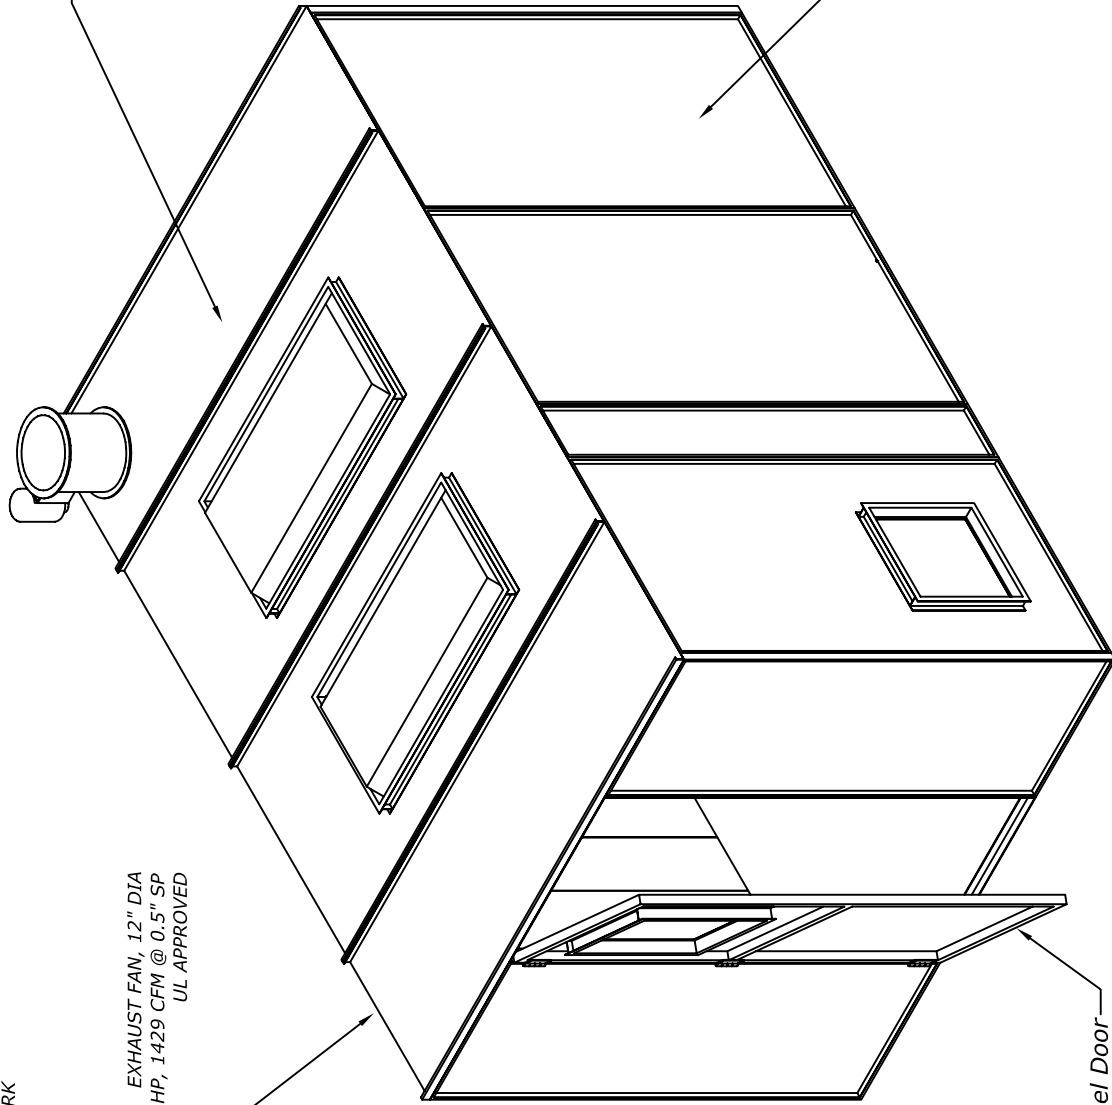

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,
 MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW
 2 FIXTURES

EXHAUST FAN, 12" DIA
 1/2 HP, 1429 CFM @ 0.5" SP
 UL APPROVED

MR-1000 MIX ROOM
 INSIDE 8'-0"W x 7'-0"H x 12'-0"L
 OUTSIDE 8'-3"W x 7'-1 1/2"H x 12'-3"L

20x20 INTAKE FILTER, FIBERGLASS

Personnel Door



Greensboro, NC 27405
 Ph - 1-800-451-2425

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.

title	MR-7812 SHT 1 OF 2
part no	MR-1000
order no	-
drawn by	R.BRIDGES
date	09-19-08
file name	XXXX
rev	A