


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,  
AND BOCA GUIDELINES

Exhaust Fan, 24" dia  
2 hp, 7800 CFM @ 0.5" SP  
UL APPROVED

NOTE:  
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND  
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO  
STARTING WORK

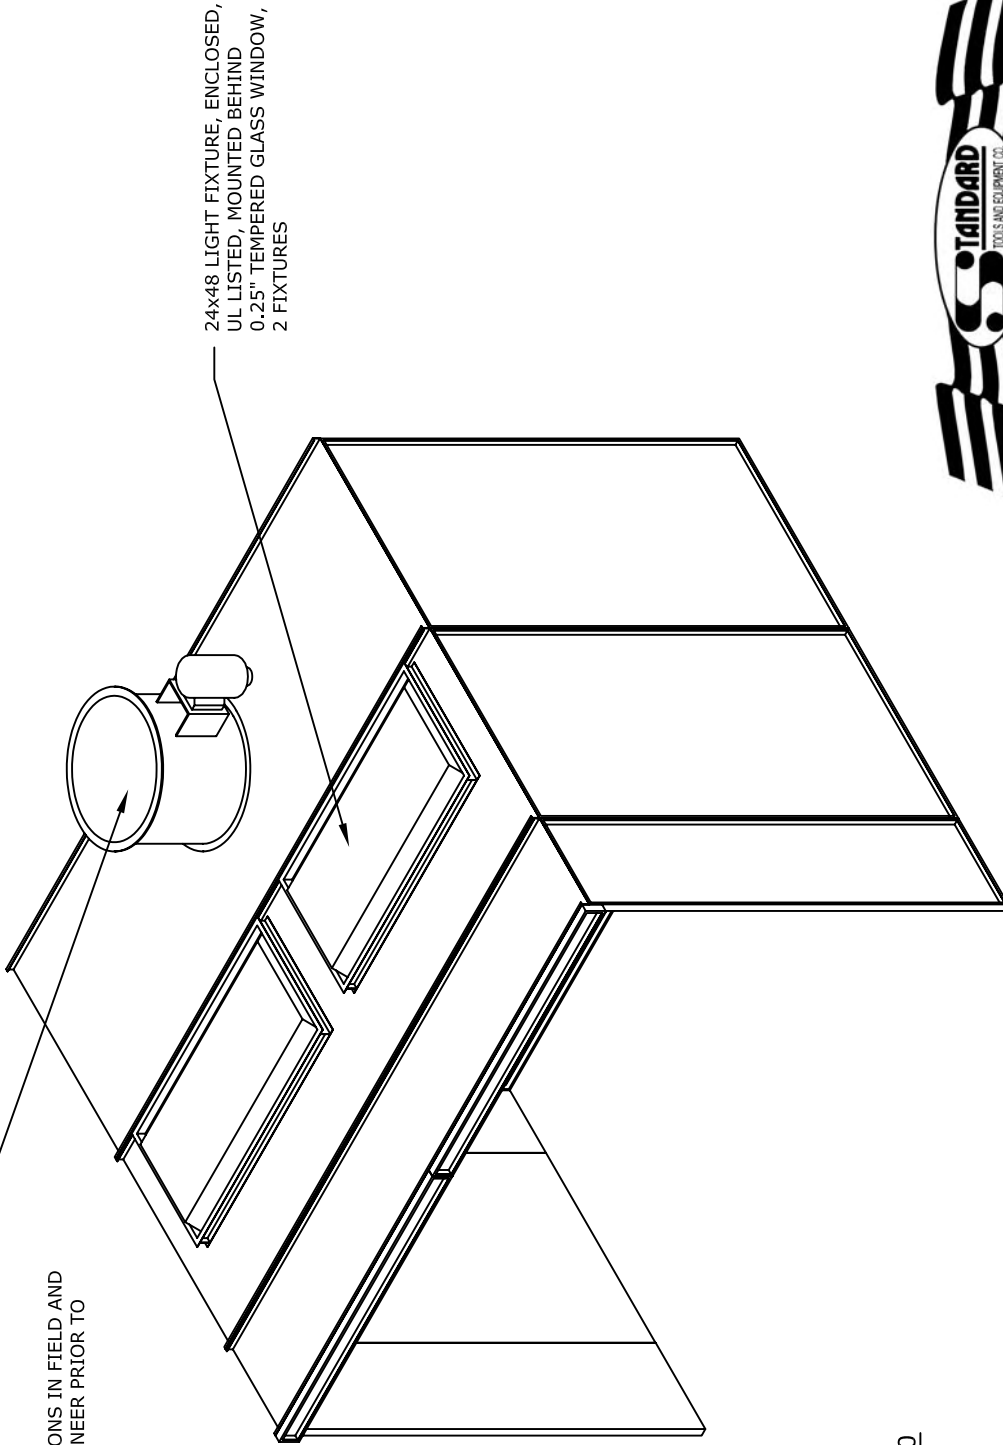

24x48 LIGHT FIXTURE, ENCLOSED,  
UL LISTED, MOUNTED BEHIND  
0.25" TEMPERED GLASS WINDOW,  
2 FIXTURES

**OPEN FACE BOOTH OFB-1000-10**

10'-3"W x 7'-1-1/2"H x 9'-0"L OUTSIDE  
10'-0"W x 7'-0"H x 6'-5"L INSIDE

**NOTES:**

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405  
Ph - 1-800-451-2425

title	OFB-1000-10 SH 1 OF 2
part no	OFB-1000-10
order no	-
drawn by	MBOWLES
date	9-28-04
file name	XXXX
rev	C