


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

Exhaust Fan, 34" dia
3hp, 13965 CFM @ 0.5" SP
UL APPROVED

NOTE;
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
STARTING WORK

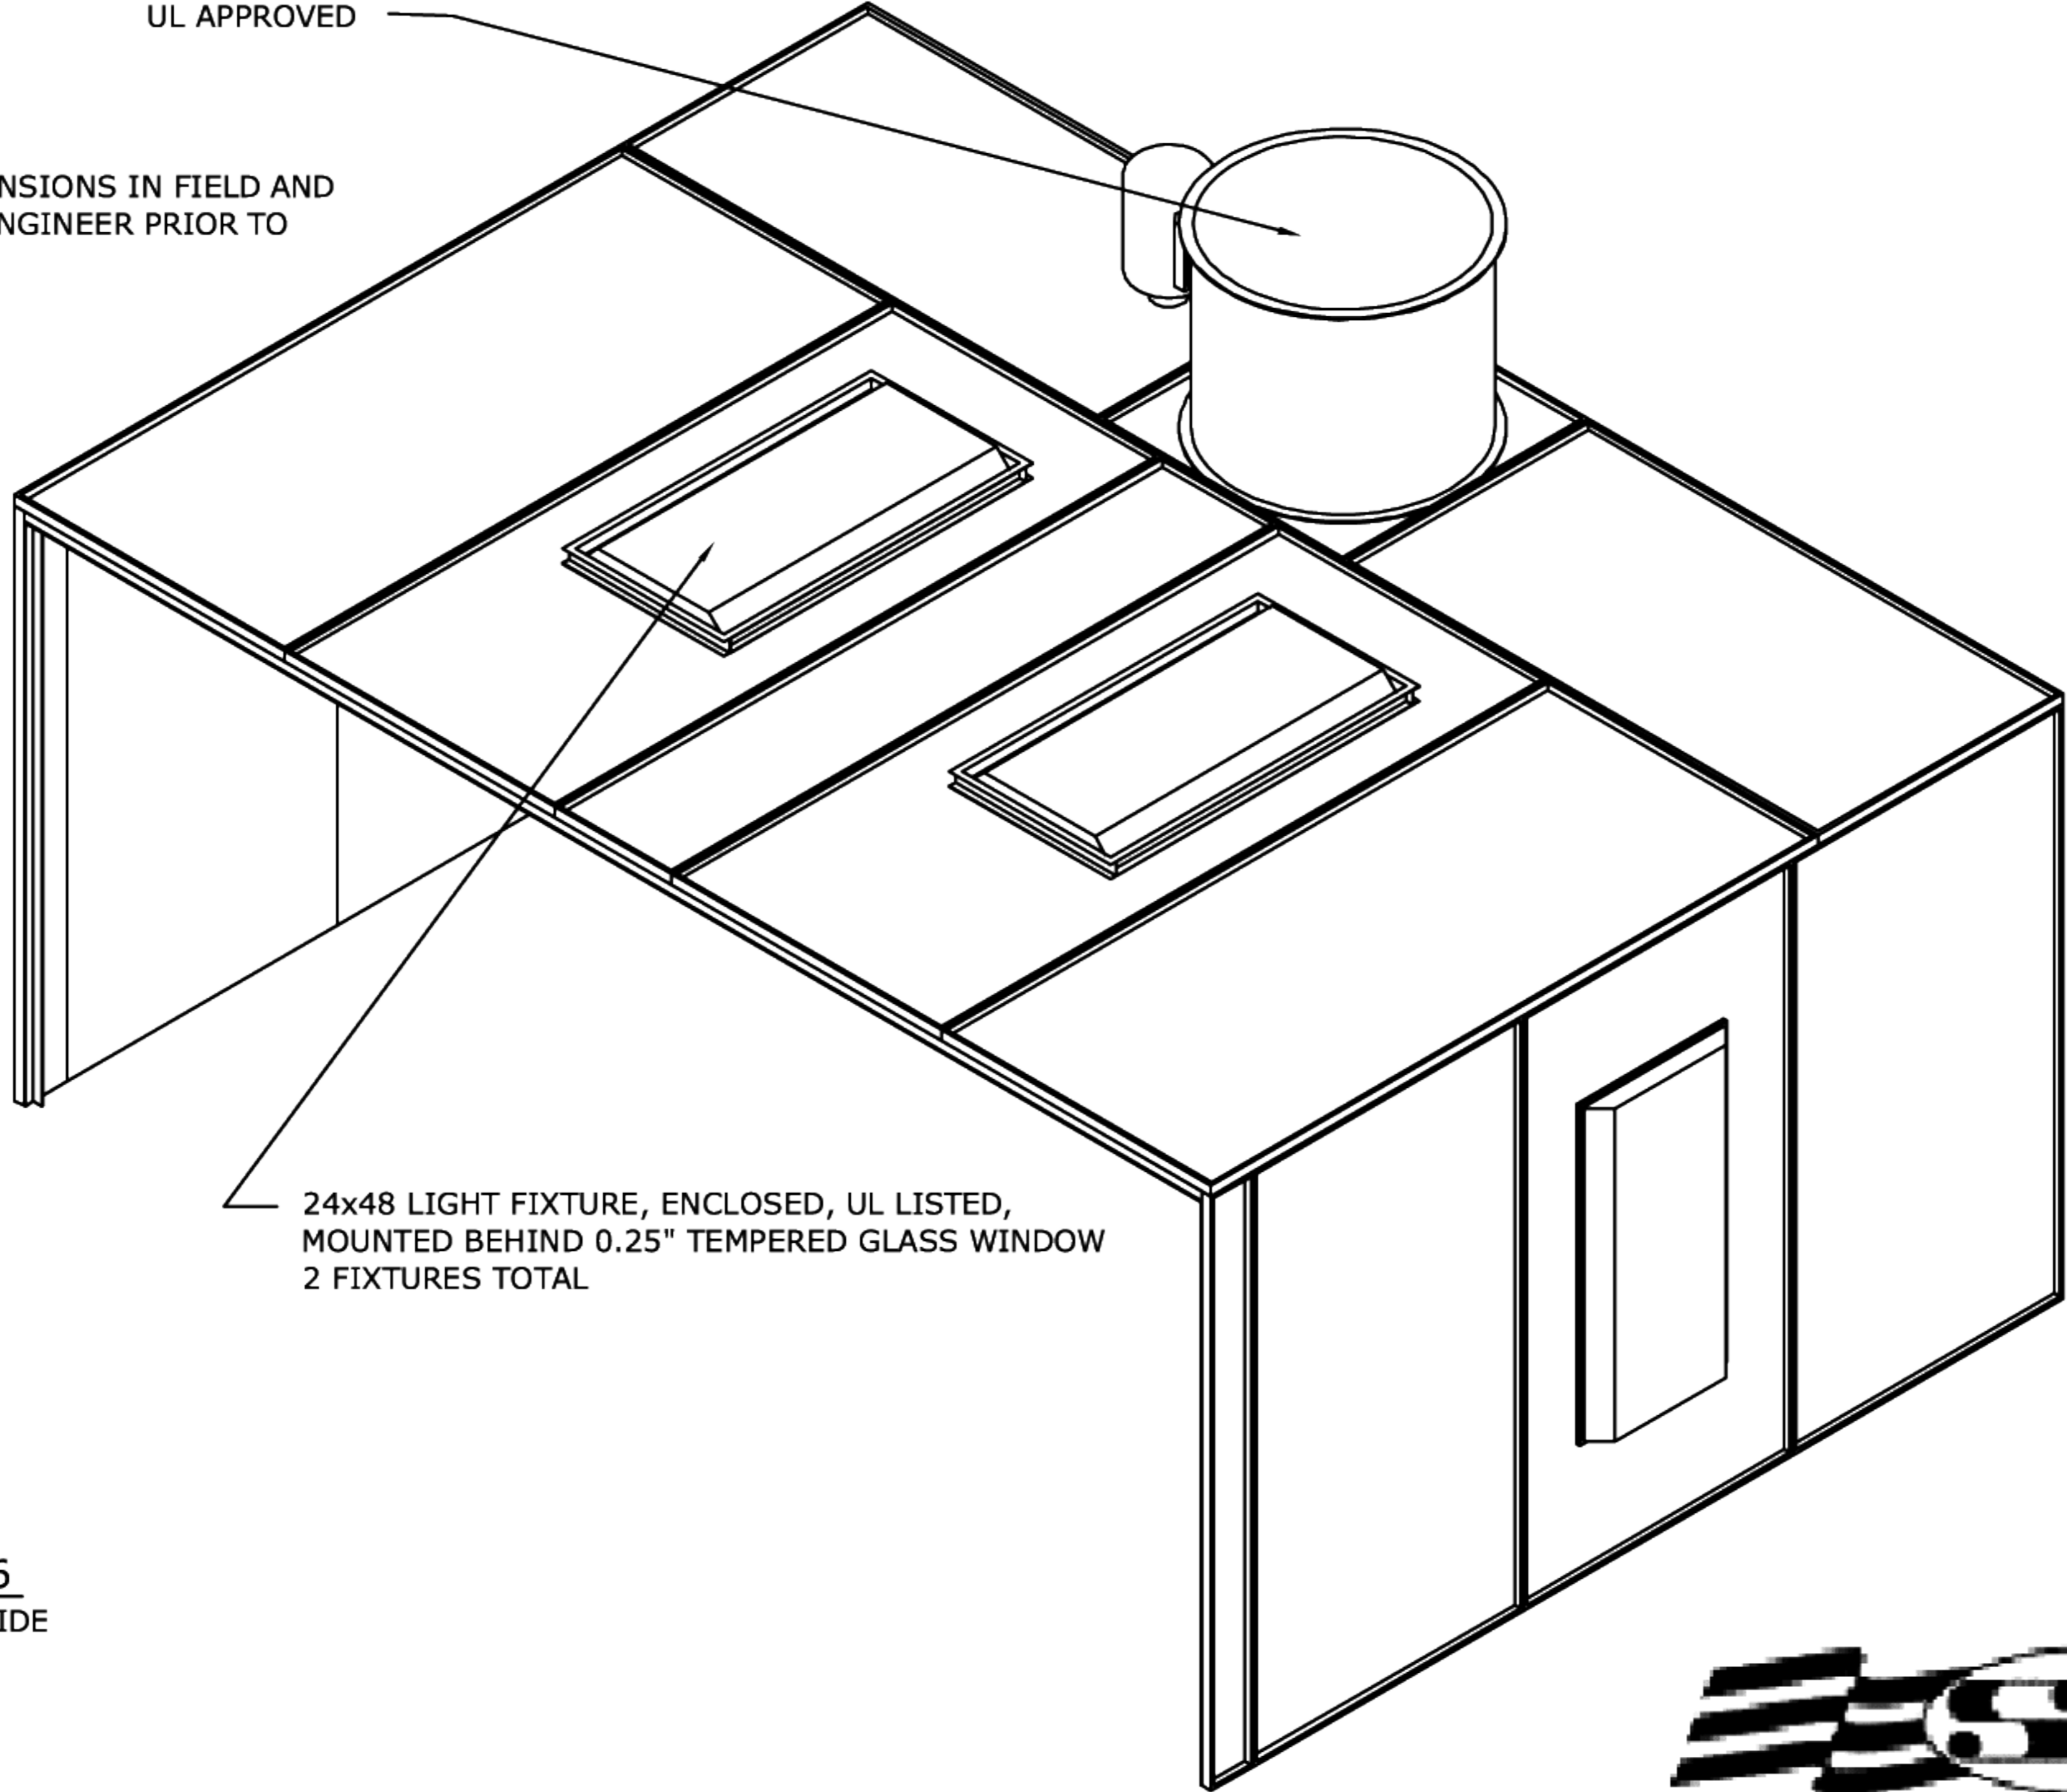

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,
MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW
2 FIXTURES TOTAL

OPEN FACE BOOTH-1000-16
16'-3"W x 7'-1-1/2"H x 11'-7"L OUTSIDE
16'-0"W x 7'-0"H x 8'-3"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
Ph - 1-800-451-2425

title	OFB-1000-16 SH 1 OF 2	
part no	OFB-1000-16	
order no	-	
drawn by	MBOWLES	date 3-11-04
file name	XXXX	rev A