


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
AND BOCA GUIDELINES

Exhaust Fan, 42" dia
3hp, 16565 CFM @ 0.5" SP
UL APPROVED

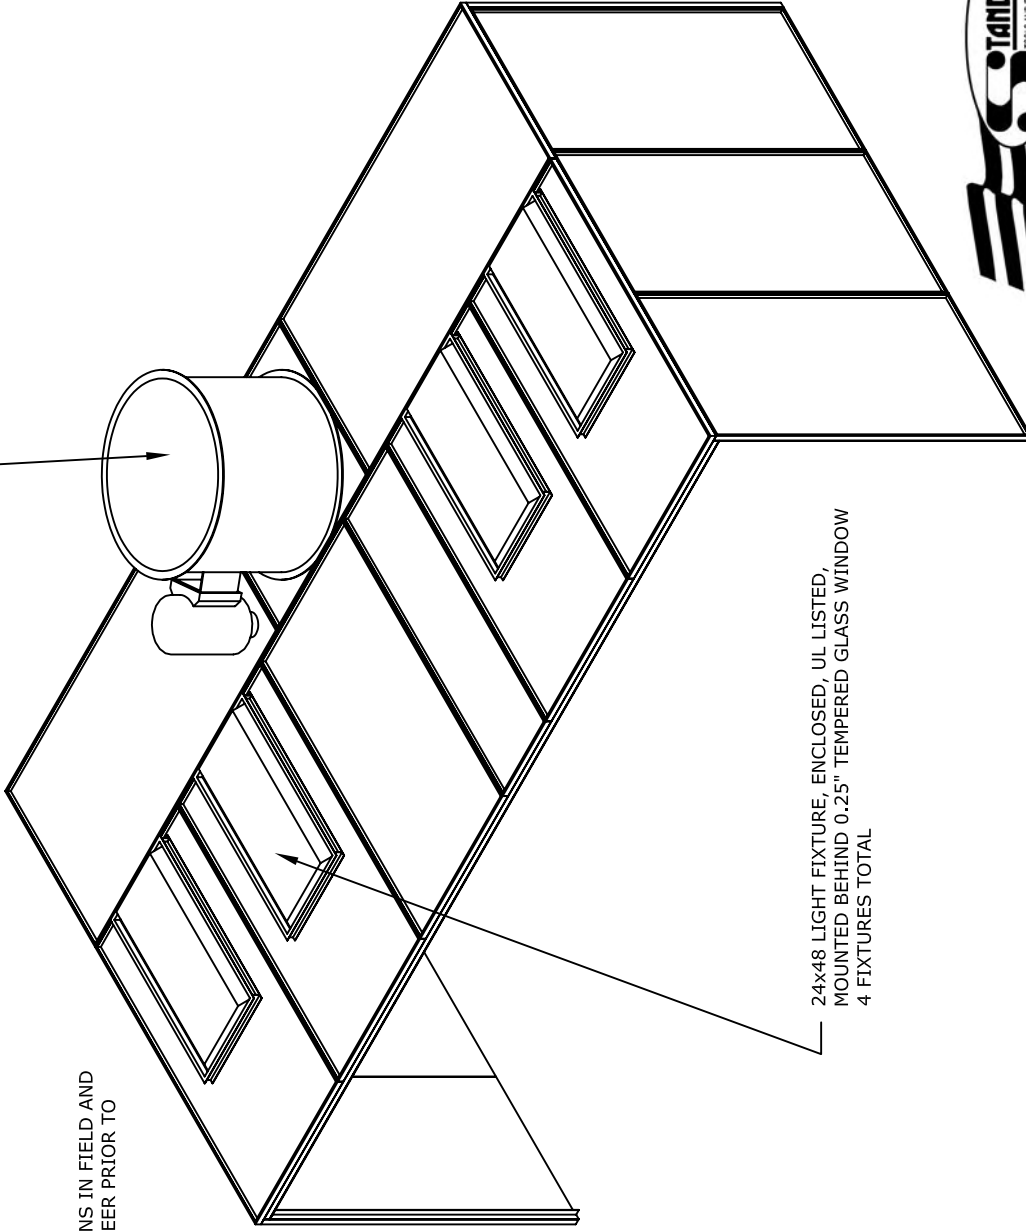

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,
MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW
4 FIXTURES TOTAL

NOTE:
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
STARTING WORK

OPEN FACE BOOTH OFB-1000-20

20'-3"W x 7'-1-1/2"H x 11'-1-1/8"L OUTSIDE
20'-0"W x 7'-0"H x 7'-1"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
Ph - 1-800-451-2425

title	OFB-1000-20 SH 1 OF 2
part no	OFB-1000-20
order no	-
drawn by	MBOWLES
file name	XXXX
date	4-22-04
rev	B