


MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,  
AND BOCA GUIDELINES

EXHAUST FAN, 24" DIA  
1 HP, 5484 CFM @ 0.5" SP  
UL APPROVED

NOTE;  
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND  
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO  
STARTING WORK

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,  
MOUNTED BEHIND 0.25" TEMPERED GLASS  
WINDOW

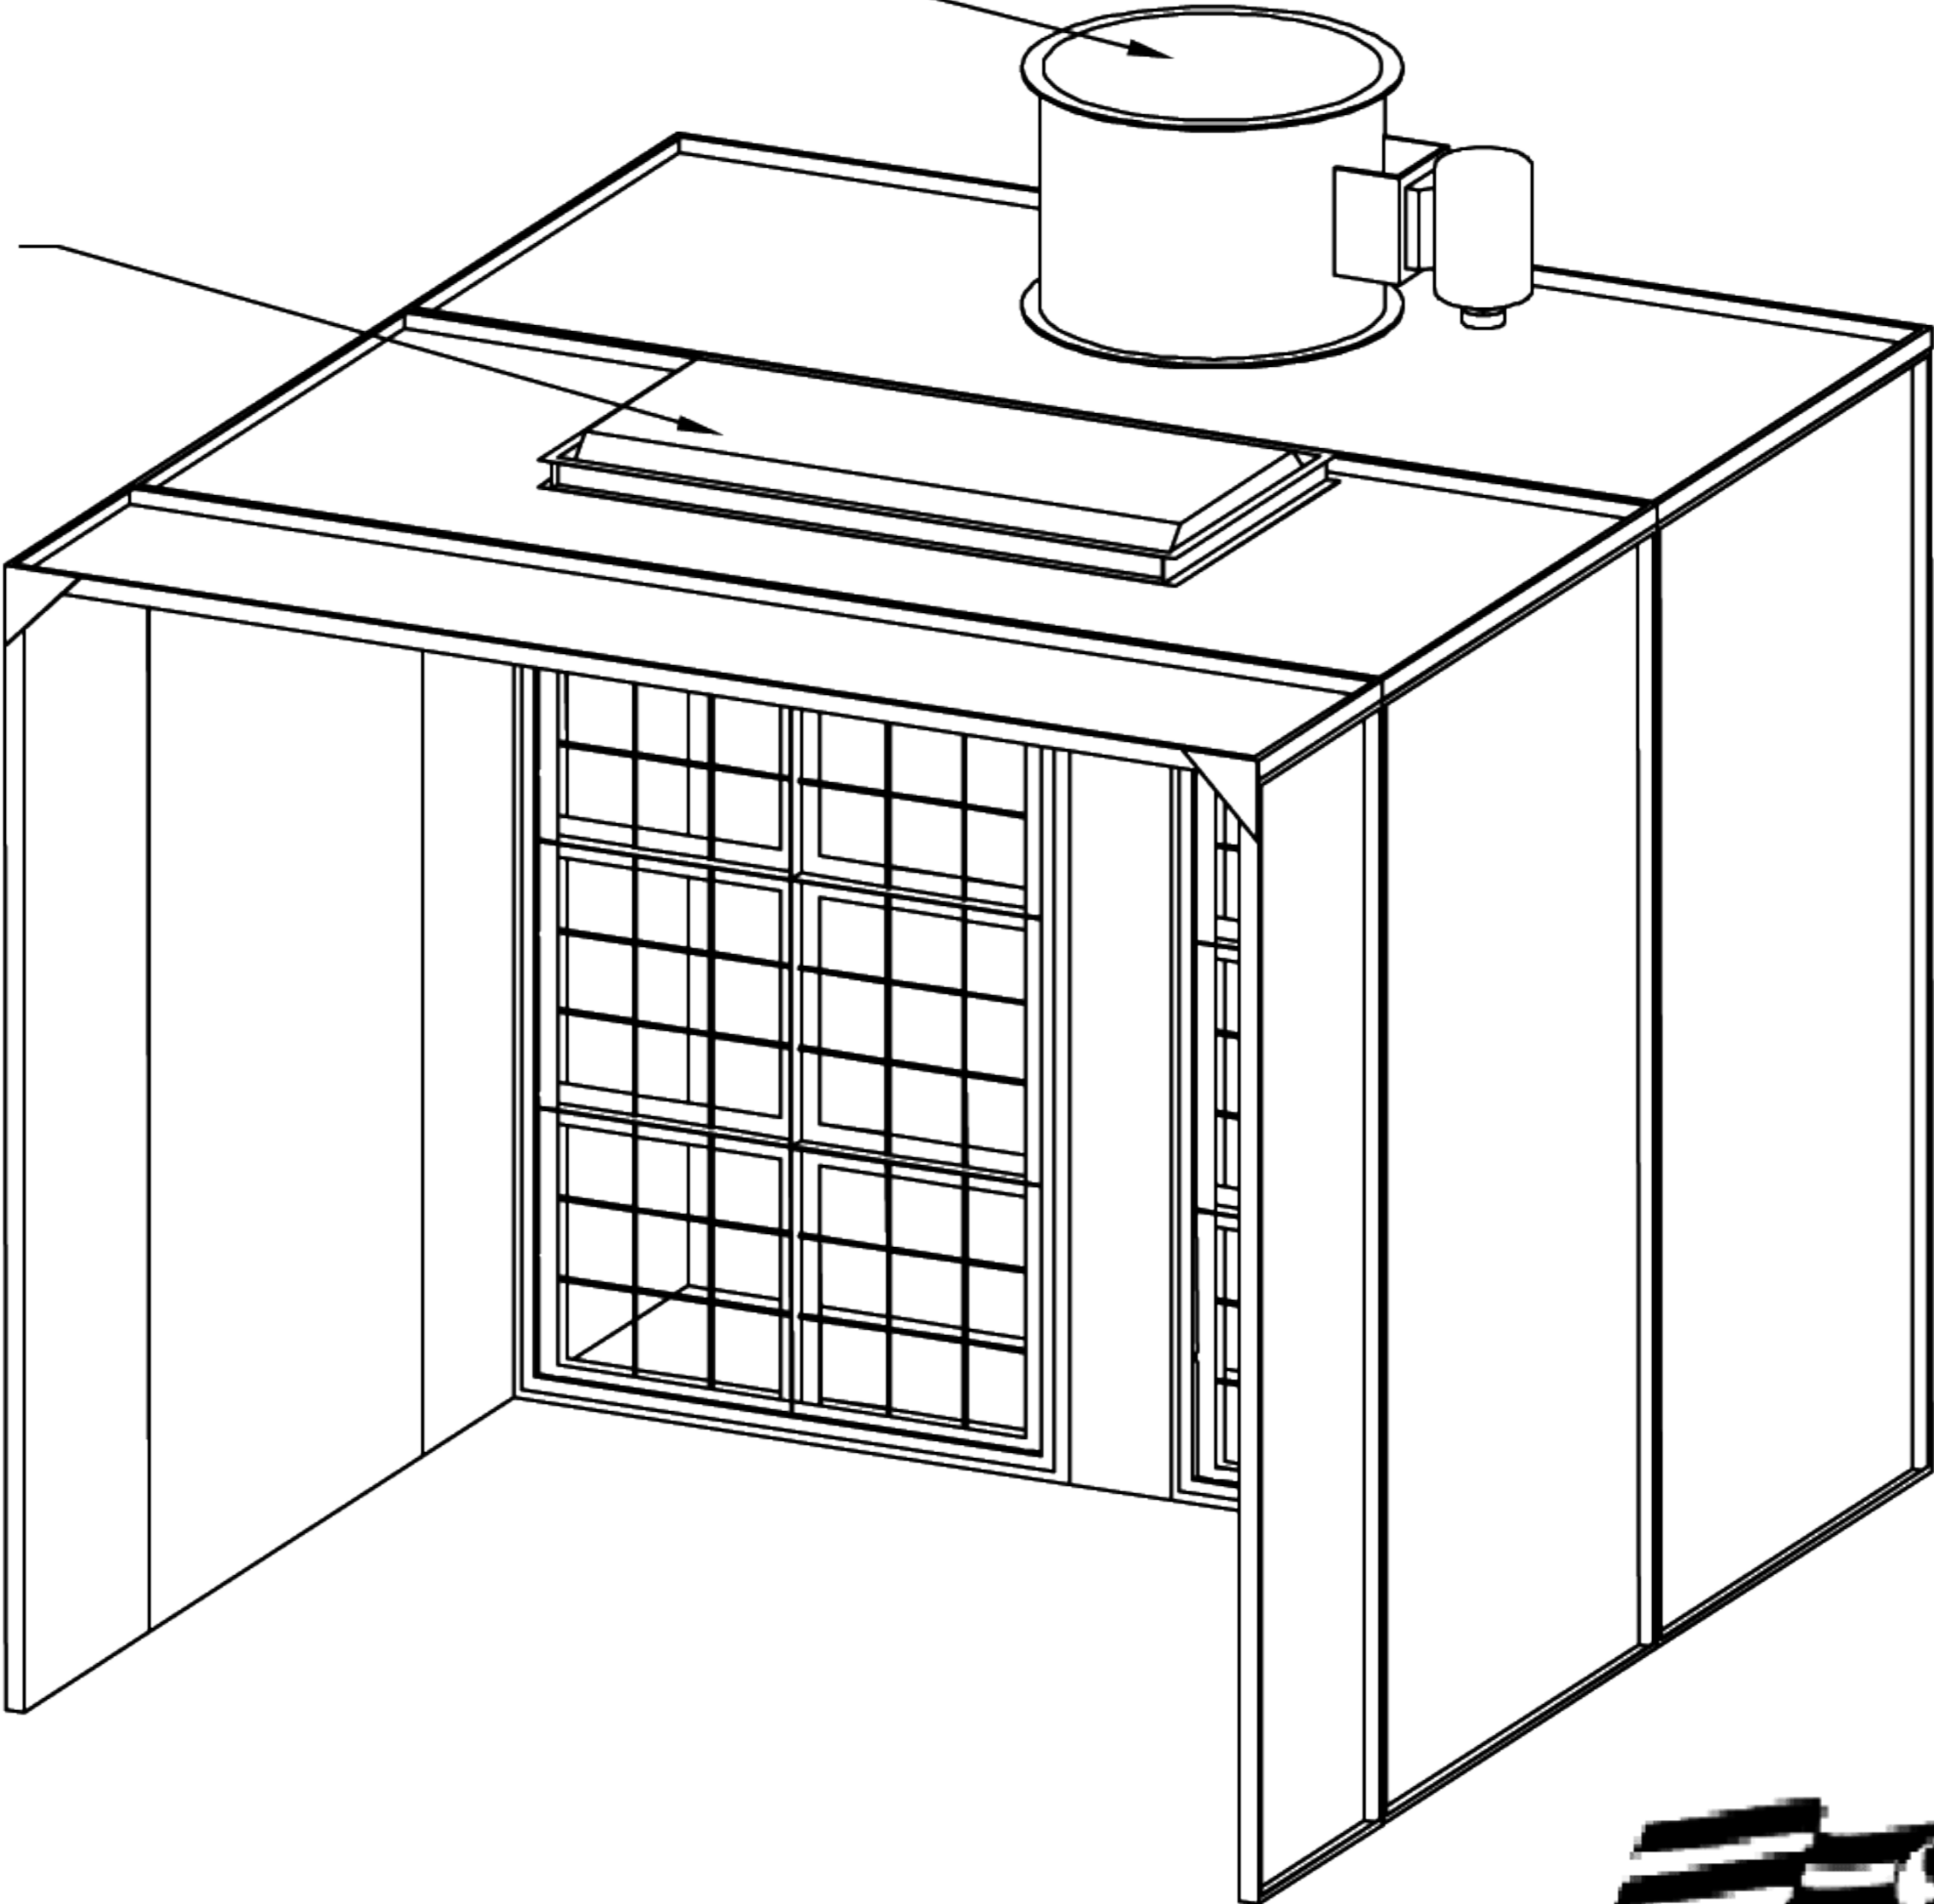

**OPEN FACE BOOTH OFB-1000**  
8'-3"W x 7'-1-1/2"H x 9'-0"L OUTSIDE  
8'-0"W x 7'-0"H x 6'-5"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405  
Ph - 1-800-451-2425

title	OFB-1000-8 SH 1 OF 2	
part no	OFB-1000-8	
order no	-	
drawn by	MBOWLES	date 4-22-04
file name	XXXX	rev B