


NOTE;
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
 REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
 STARTING WORK

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
 AND BOCA GUIDELINES

Exhaust Fan, 24" dia
 2 hp, 7983 CFM @ 0.5" SP
 UL APPROVED

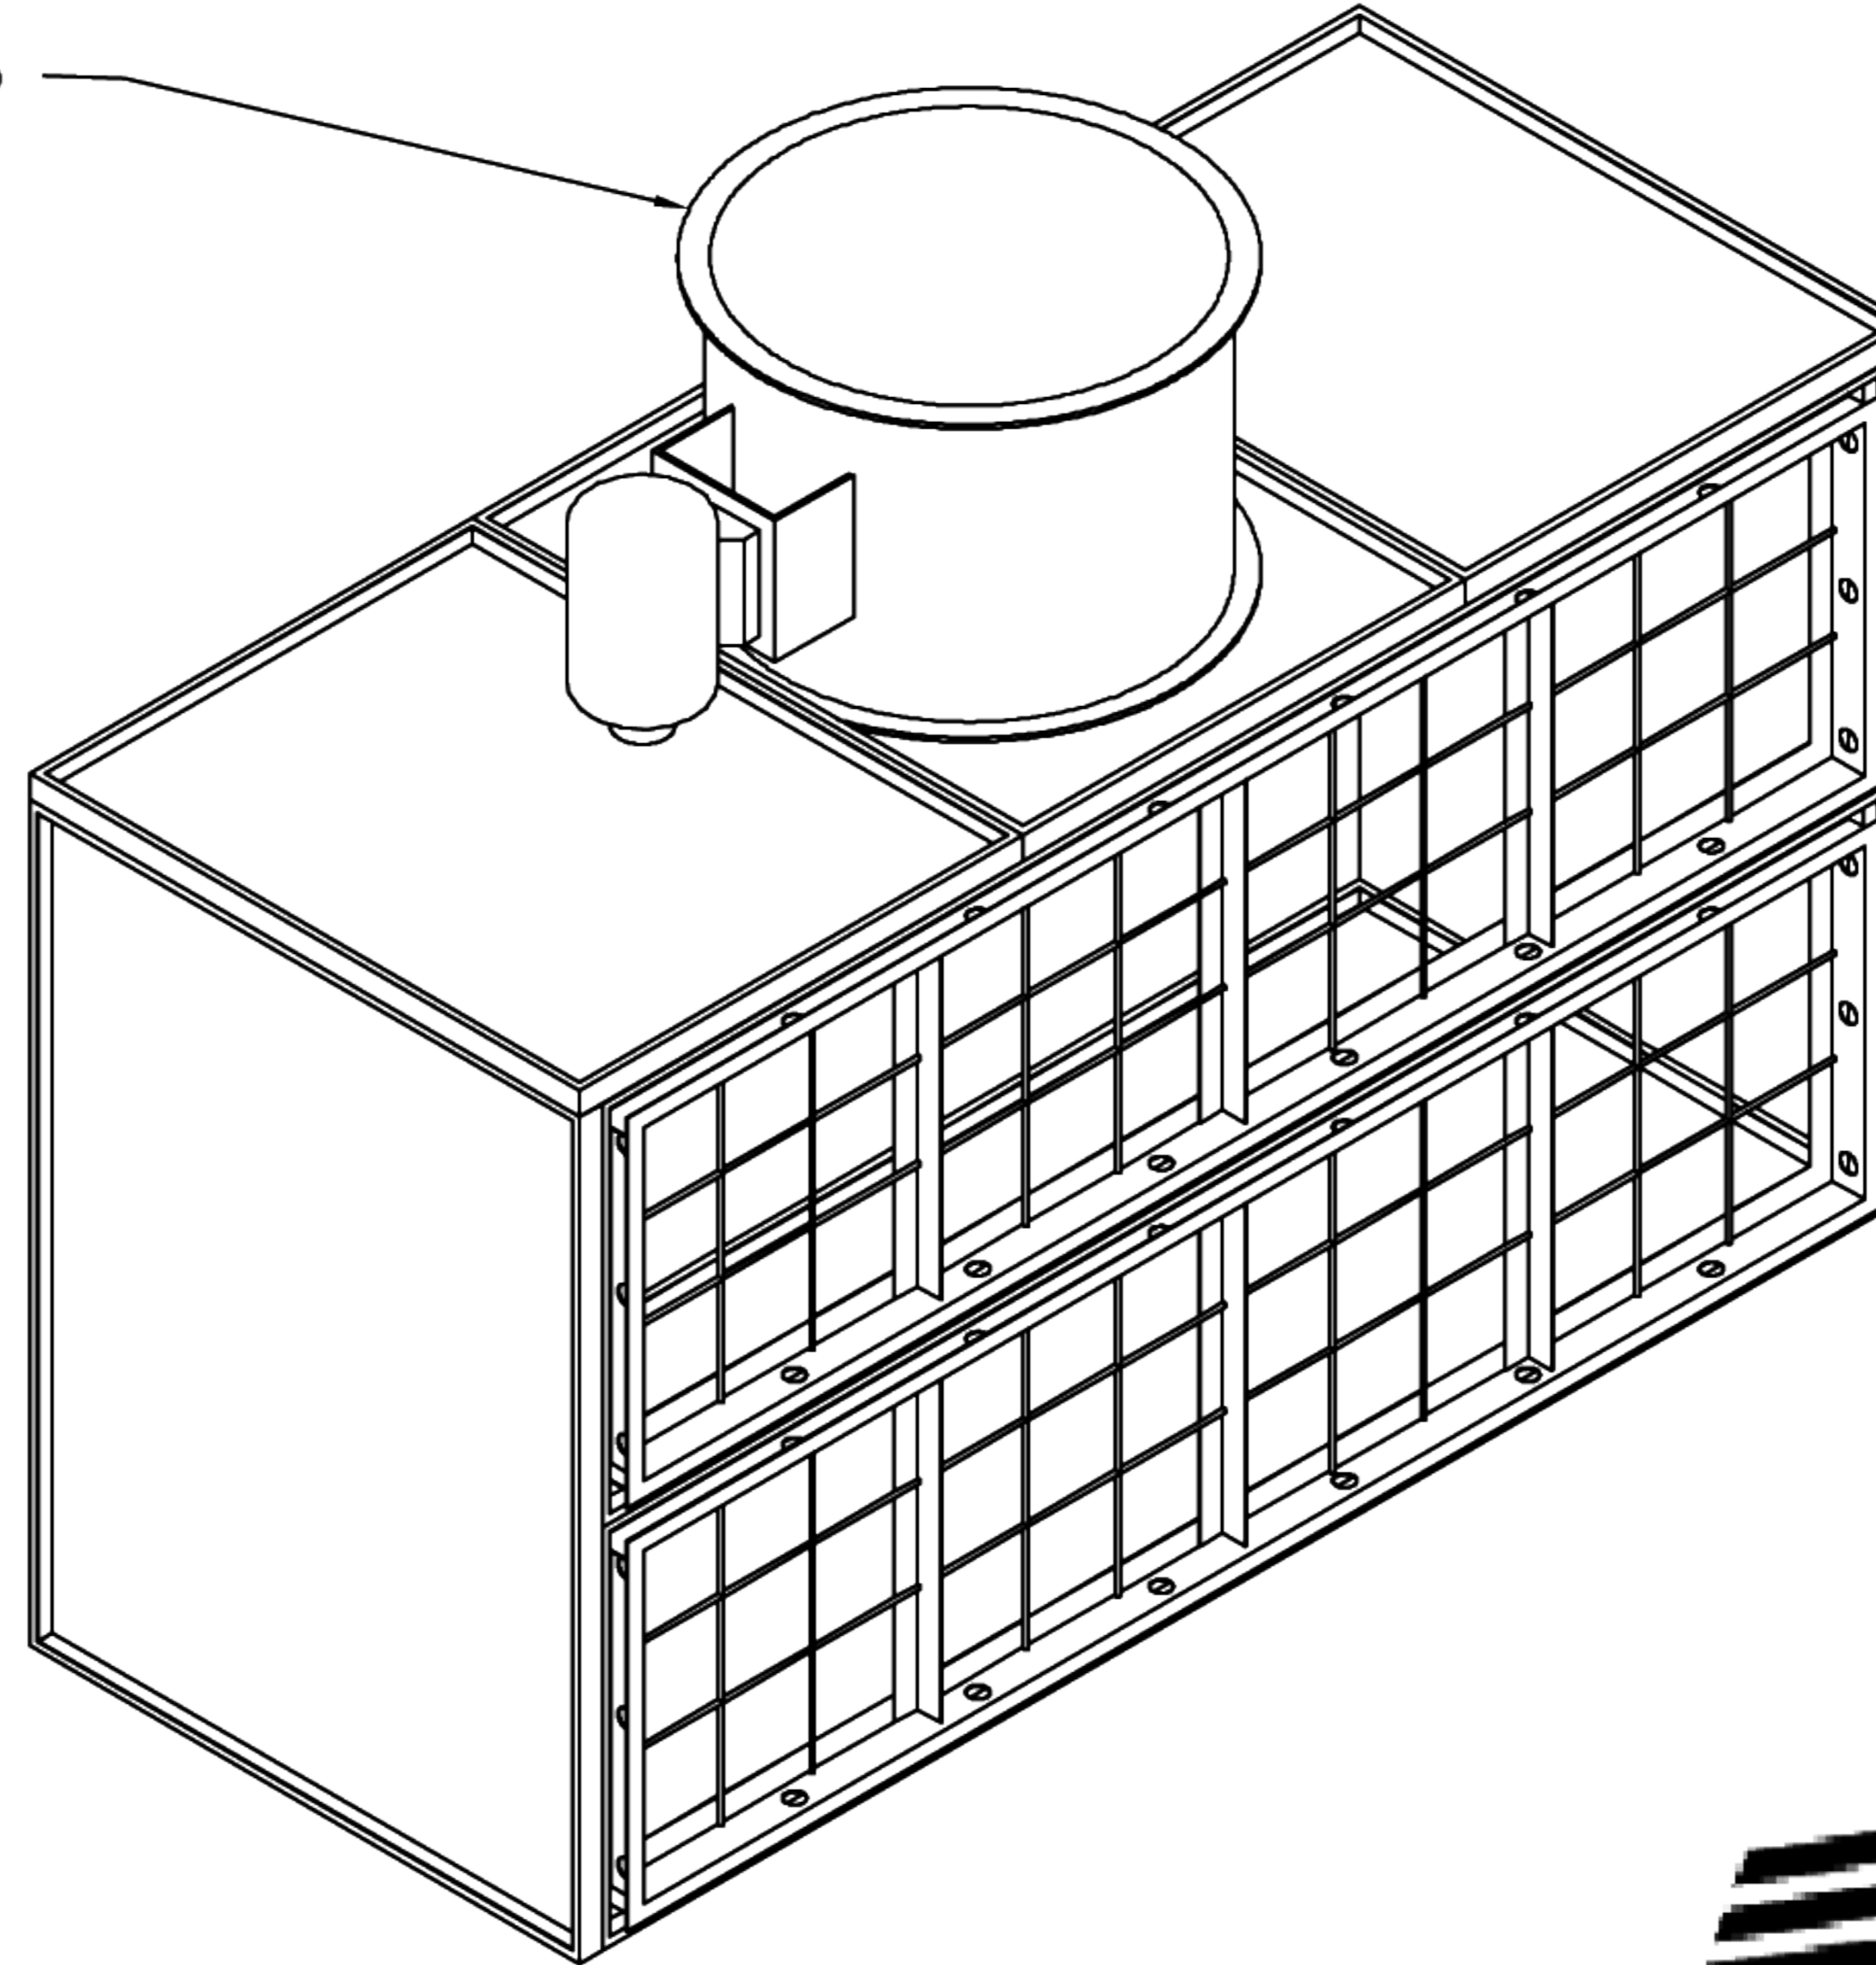

PAINT FLOOR FILTER BOX

PFFB-1000
 87" W x 36" D x 49.5" H

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
 Ph - 1-800-451-2425

title		PFFB-1000 SHEET 1 OF 2	
part no		PFFB-1000	
order no		76716	
drawn by	MBOWLES	date	10-21-03
file name	XXXX	rev	A