

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC, AND BOCA GUIDELINES


NOTE:
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO STARTING WORK

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED, MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW 10 FIXTURES TOTAL

Exhaust Fan, 30" dia
2 hp, 12,190 CFM @ 0.5" SP
UL APPROVED

FIBERGLAS FILTERS
FLAMMABILITY UL CLASS 2

Exhaust Fan, 30" dia
3 hp, 12,190 CFM @ 0.5" SP
UL APPROVED

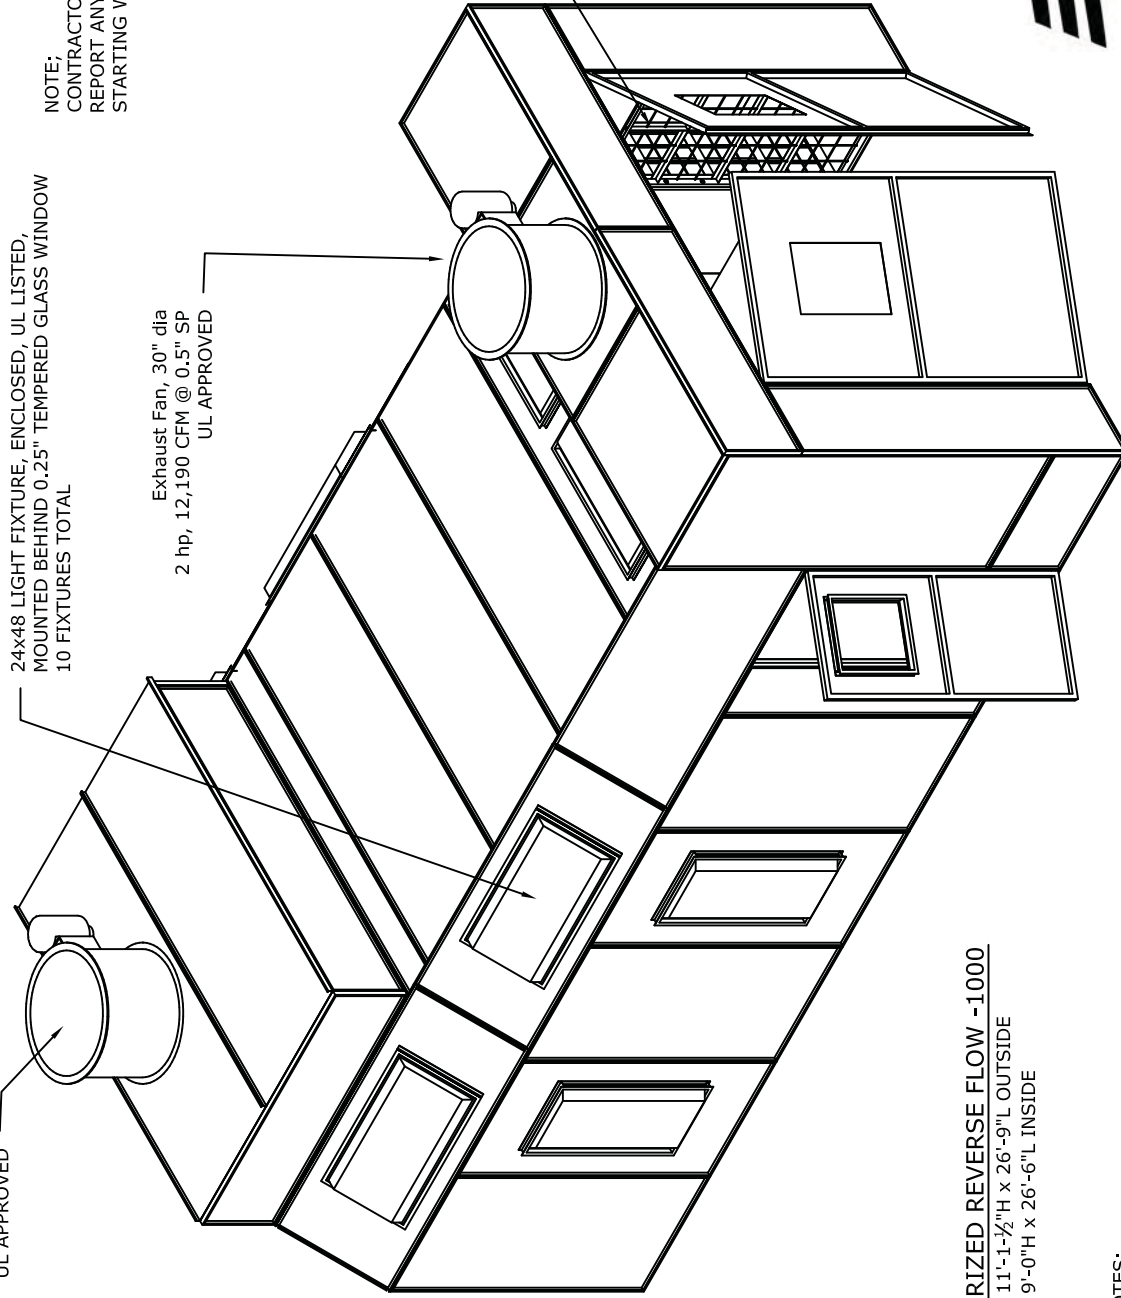

PRESSURIZED REVERSE FLOW -1000

14'-3"W x 11'-1-1/2"H x 26'-9"L OUTSIDE
14'-0"W x 9'-0"H x 26'-6"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



Greensboro, NC 27405
Ph - 1-800-451-2425

title	PRF-1000 SH 1 OF 2
part no	PRF-1000
order no	-
drawn by	MBOWLES
date	6-20-05
file name	XXXX
rev	B