


NOTE:
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
 REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
 STARTING WORK

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,
 AND BOCA GUIDELINES

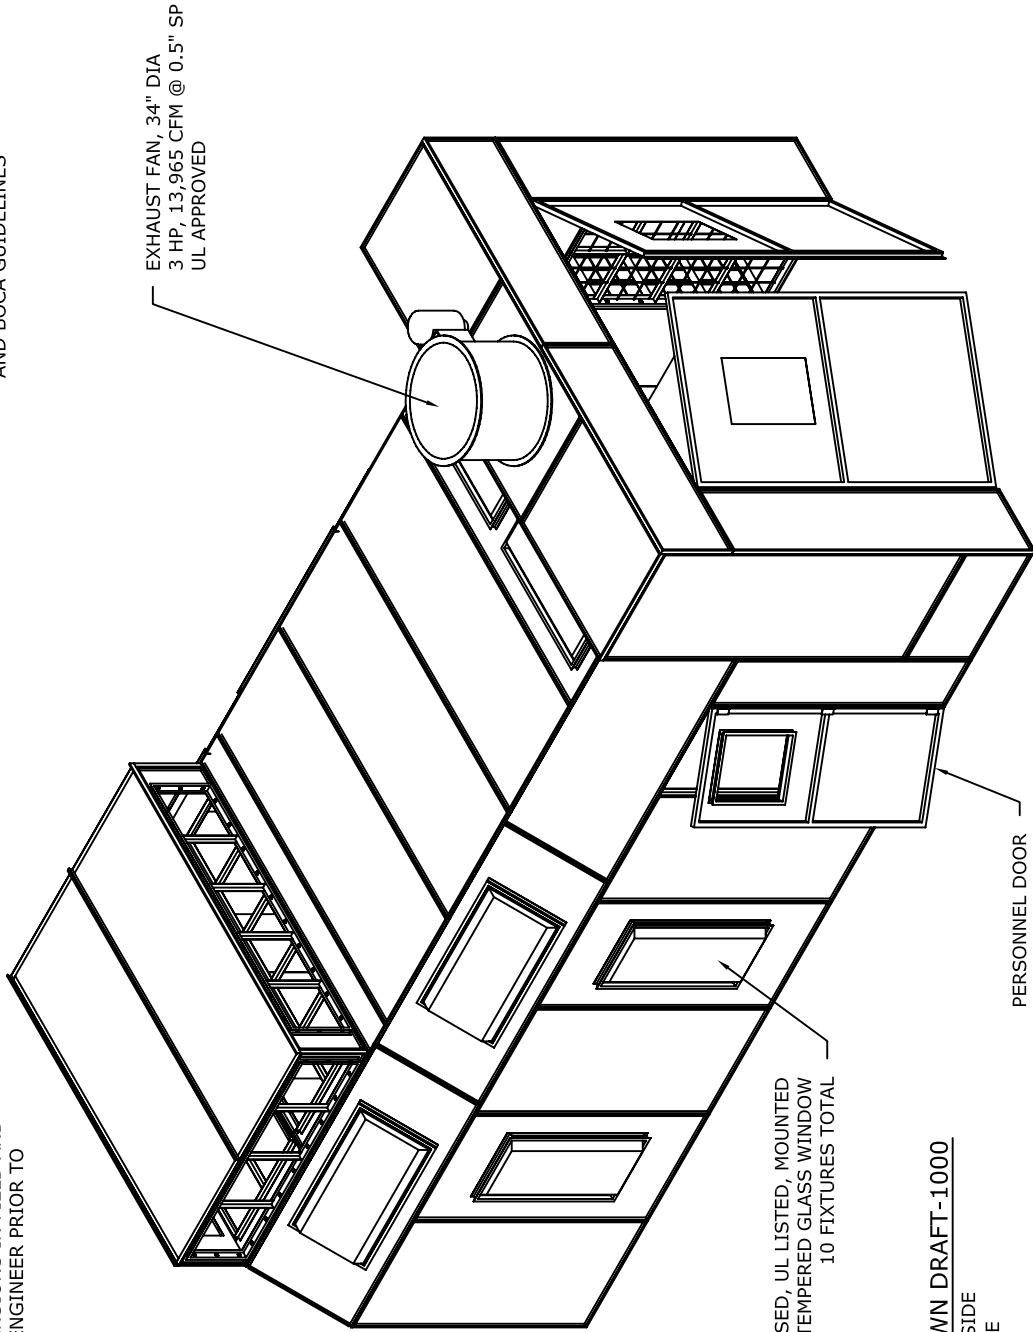

EXHAUST FAN, 34" DIA
 3 HP, 13,965 CFM @ 0.5" SP
 UL APPROVED

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED, MOUNTED
 BEHIND 0.25" TEMPERED GLASS WINDOW
 10 FIXTURES TOTAL

PERSONNEL DOOR

REVERSE FLOW SEMI-DOWN DRAFT-1000

14'-3"W x 11'-3"H x 26'-9"L OUTSIDE
 14'-0"W x 9'-0"H x 26'-6"L INSIDE



Greensboro, NC 27405
 Ph - 1-800-451-2425

title	RFSD-1000 SH 1 OF 2
part no	RFSD-1000
order no	-
drawn by	MBOWLES
date	6-23-05
file name	XXXX
rev	A

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.