


NOTE;  
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND  
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO  
STARTING WORK

**TRUCK CROSS FLOW-1000**  
17'-0"W x 16'-8"H x 40'-0"L OUTSIDE  
16'-0"W x 16'-2"H x 39'-9"L INSIDE

EXHAUST FAN, 42" DIA, 5 HP,  
21,435 CFM @ 0.5" SP  
UL APPROVED

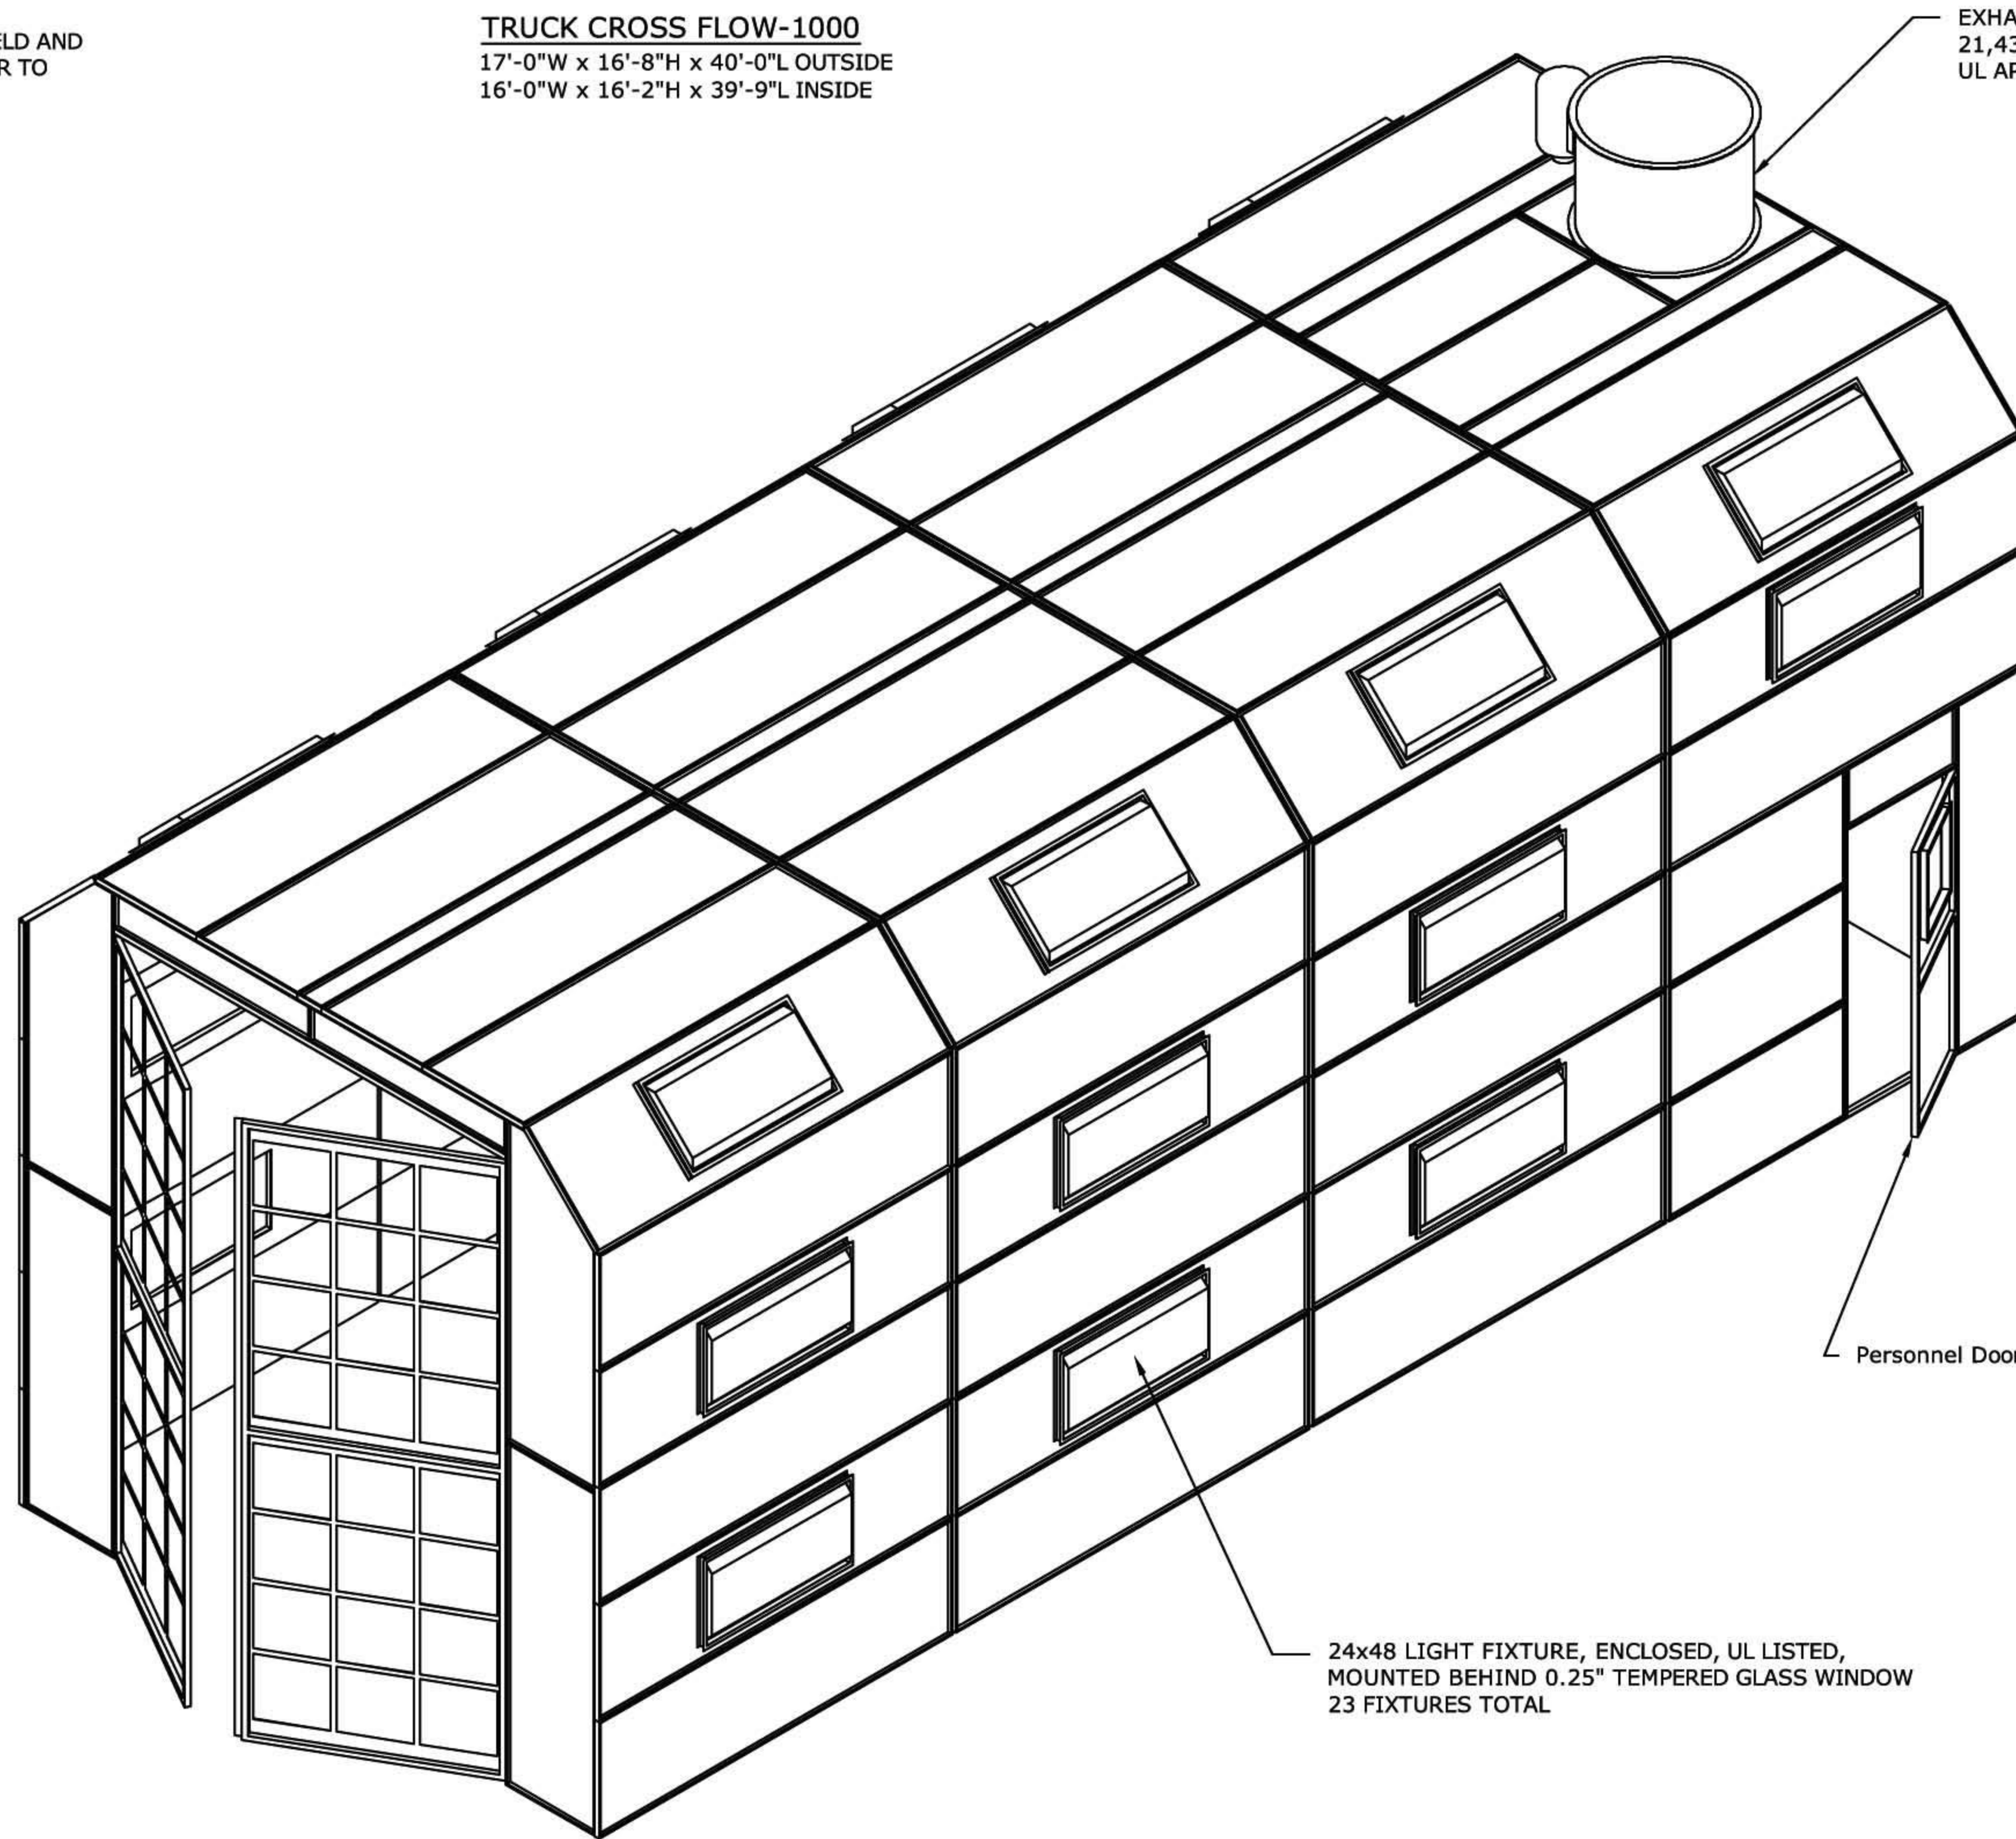

Personnel Door

24x48 LIGHT FIXTURE, ENCLOSED, UL LISTED,  
MOUNTED BEHIND 0.25" TEMPERED GLASS WINDOW  
23 FIXTURES TOTAL

**NOTES:**

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.



MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, NEC,  
AND BOCA GUIDELINES

title		STCF-40 SHEET 1 OF 3	
part no		STCF-1000	
order no		-	
drawn by		date	
file name	XXXX	rev	A