


NOTE;
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
 REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
 STARTING WORK

COMPONENTS PROVIDED BY OTHERS:

- WIRING
- MC CABLE
- CONDUIT
- JUNCTION BOXES
- DISCONNECT

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA,
 AND NEC GUIDELINES

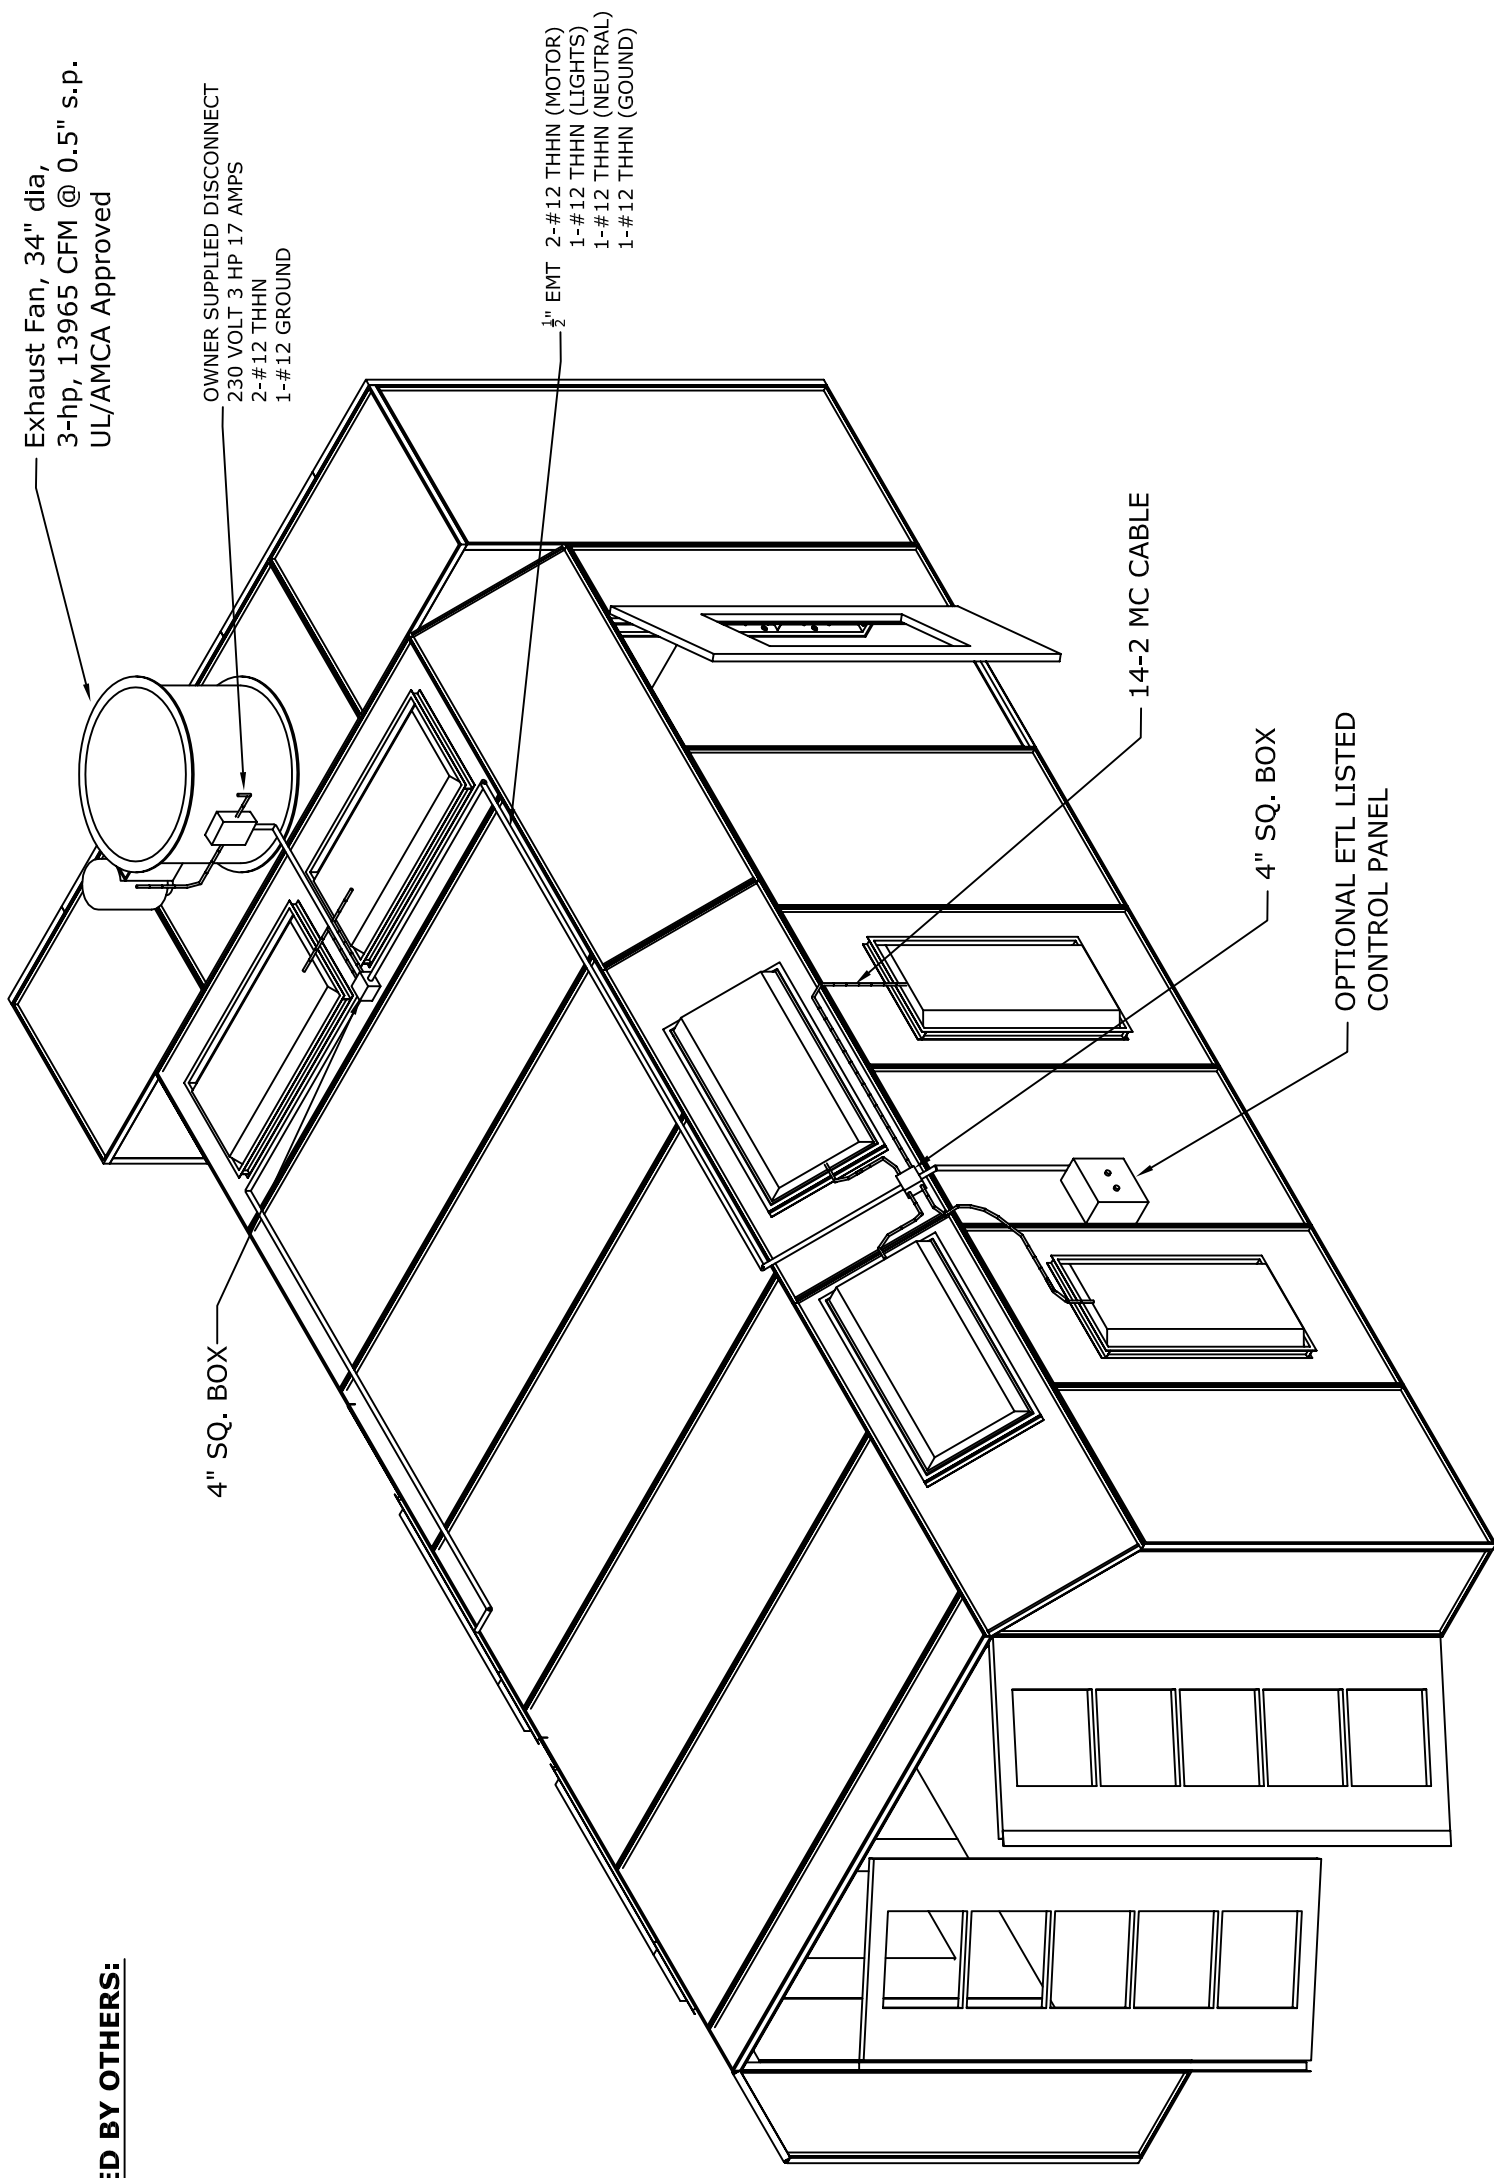

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.
- ALL ELECTRICAL THAN 3' FROM ANY BOOTH OPENING

STANDARD TOOLS AND EQUIPMENT CO.

Greensboro, NC 27405

Ph - 1-800-451-2425

title	CF-1000-ELECTRICAL RECOMMENDATION
part no	CF-1000
order no	-
drawn by	J.DEHART
date	3-5-13
file name	XXXX
rev	A