


Exhaust Fan, 30" dia  
3 hp, 12,200 CFM @ 0.5" SP  
UL APPROVED  
MOTOR DISCONNECT  
SUPPLIED BY OTHERS

NOTE:  
CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND  
REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO  
STARTING WORK

**COMPONENTS PROVIDED BY OTHERS:**

- WIRING
- MC CABLE
- CONDUIT
- JUNCTION BOXES
- DISCONNECT

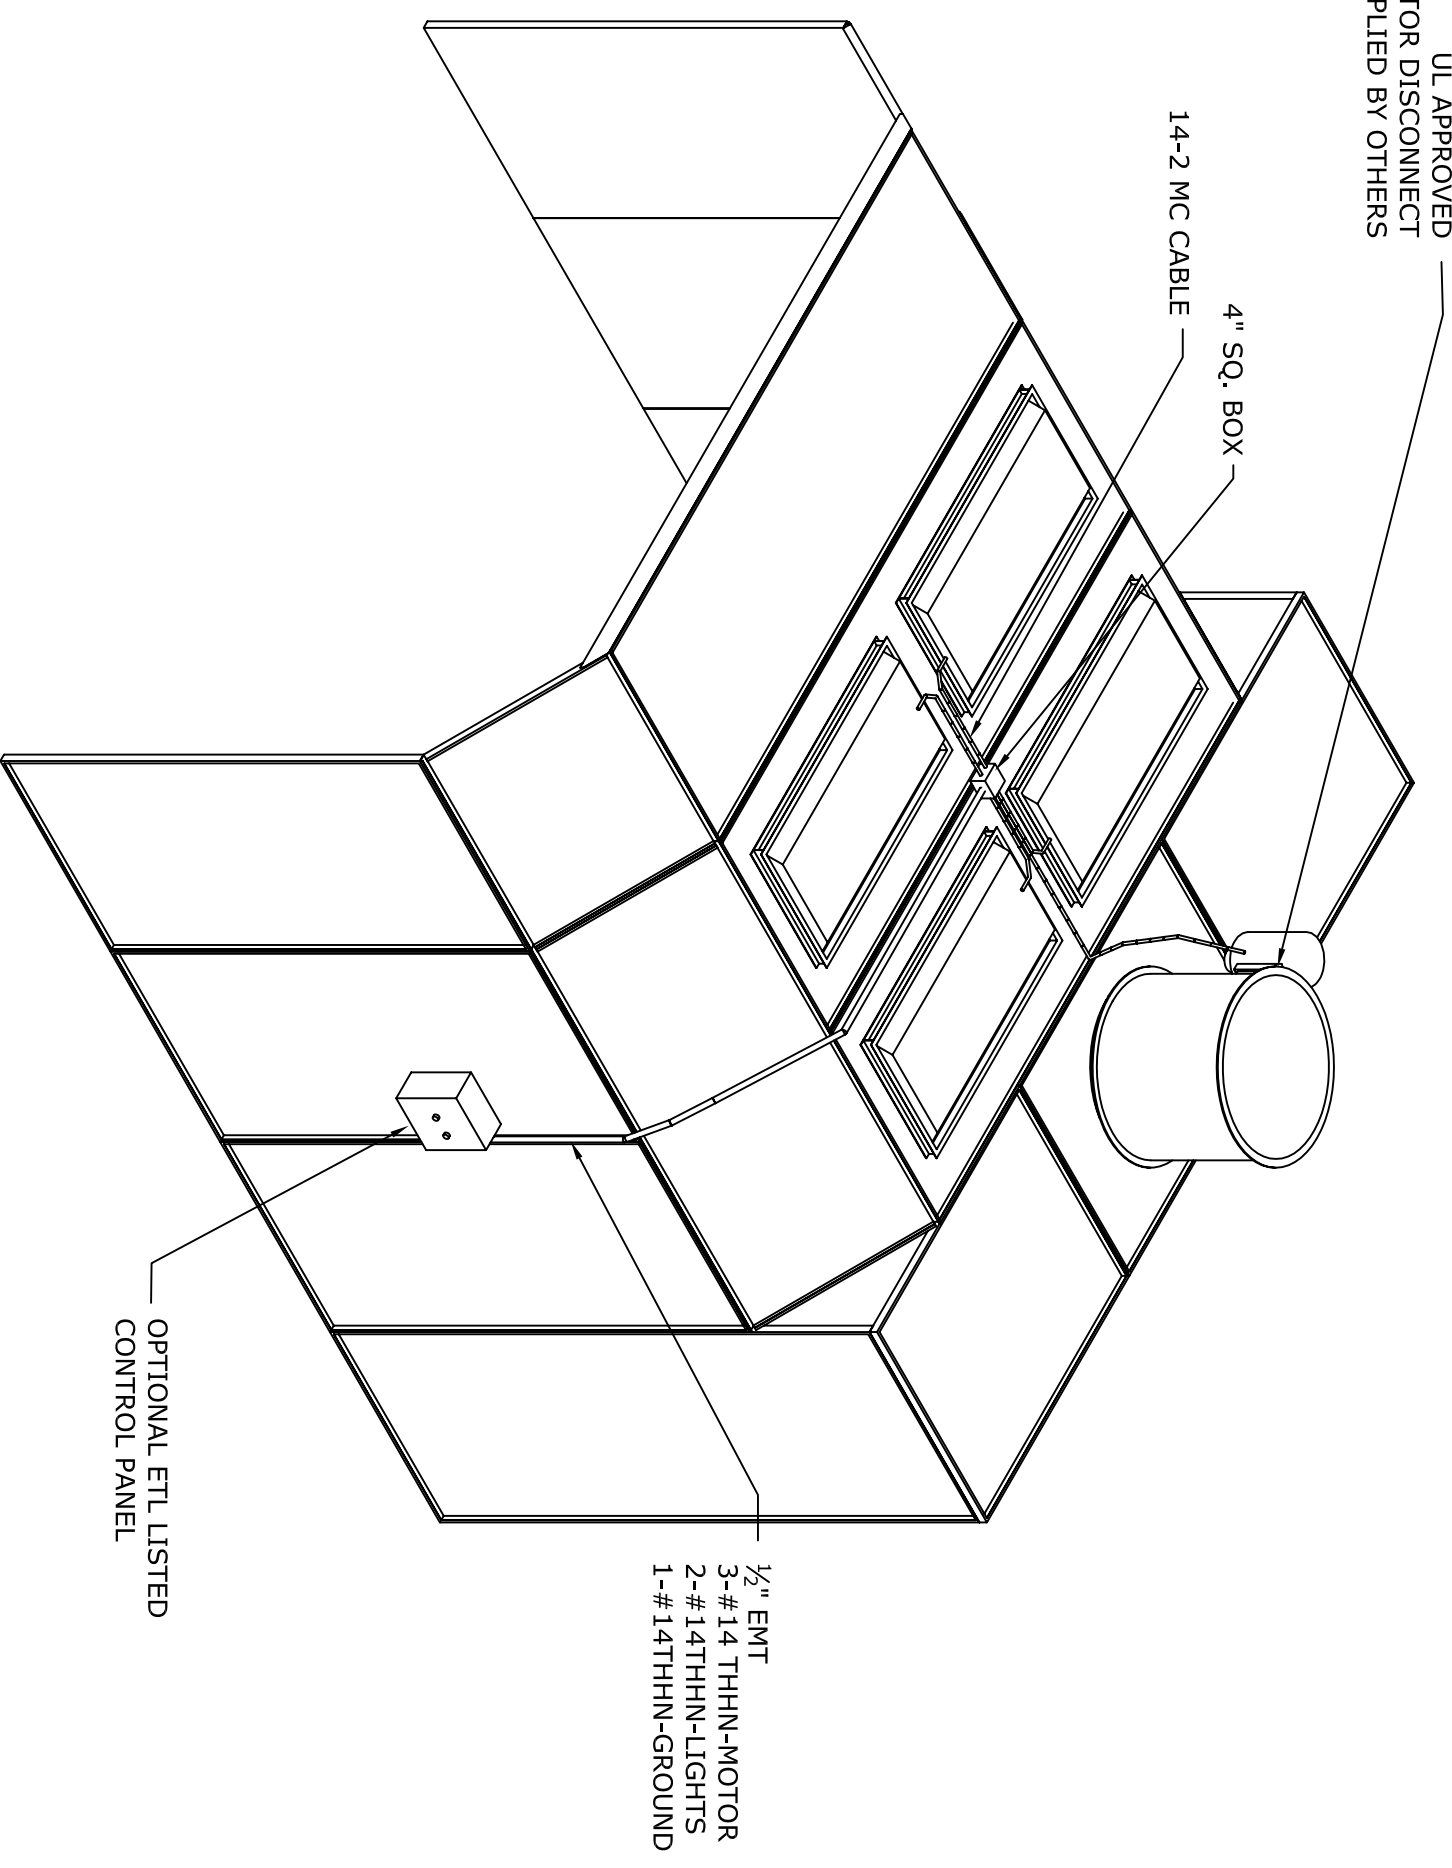

**INDUSTRIAL PAINT WALL-1000**

14'-3"W x 9'-1-1/2"H x 14'-8"L OUTSIDE  
14'-0"W x 9'-0"H x 11'-0"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.
- ALL ELECTRICAL MORE THAN 3'FROM ANY BOOTH OPENING

**STANDARD TOOLS AND EQUIPMENT CO.**

Greensboro, NC 27405

Ph - 1-800-451-2425

title IPW-1000-148 ELECTRICAL RECOMMENDATION

part no IPW-1000-148

order no -

drawn by J.DEHART

date 3-13-13

file name XXXX

rev A