


NOTE:
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
 REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
 STARTING WORK

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA,
 AND NEC GUIDELINES

COMPONENTS PROVIDED BY OTHERS:

- WIRING
- MC CABLE
- CONDUIT
- JUNCTION BOXES
- DISCONNECT

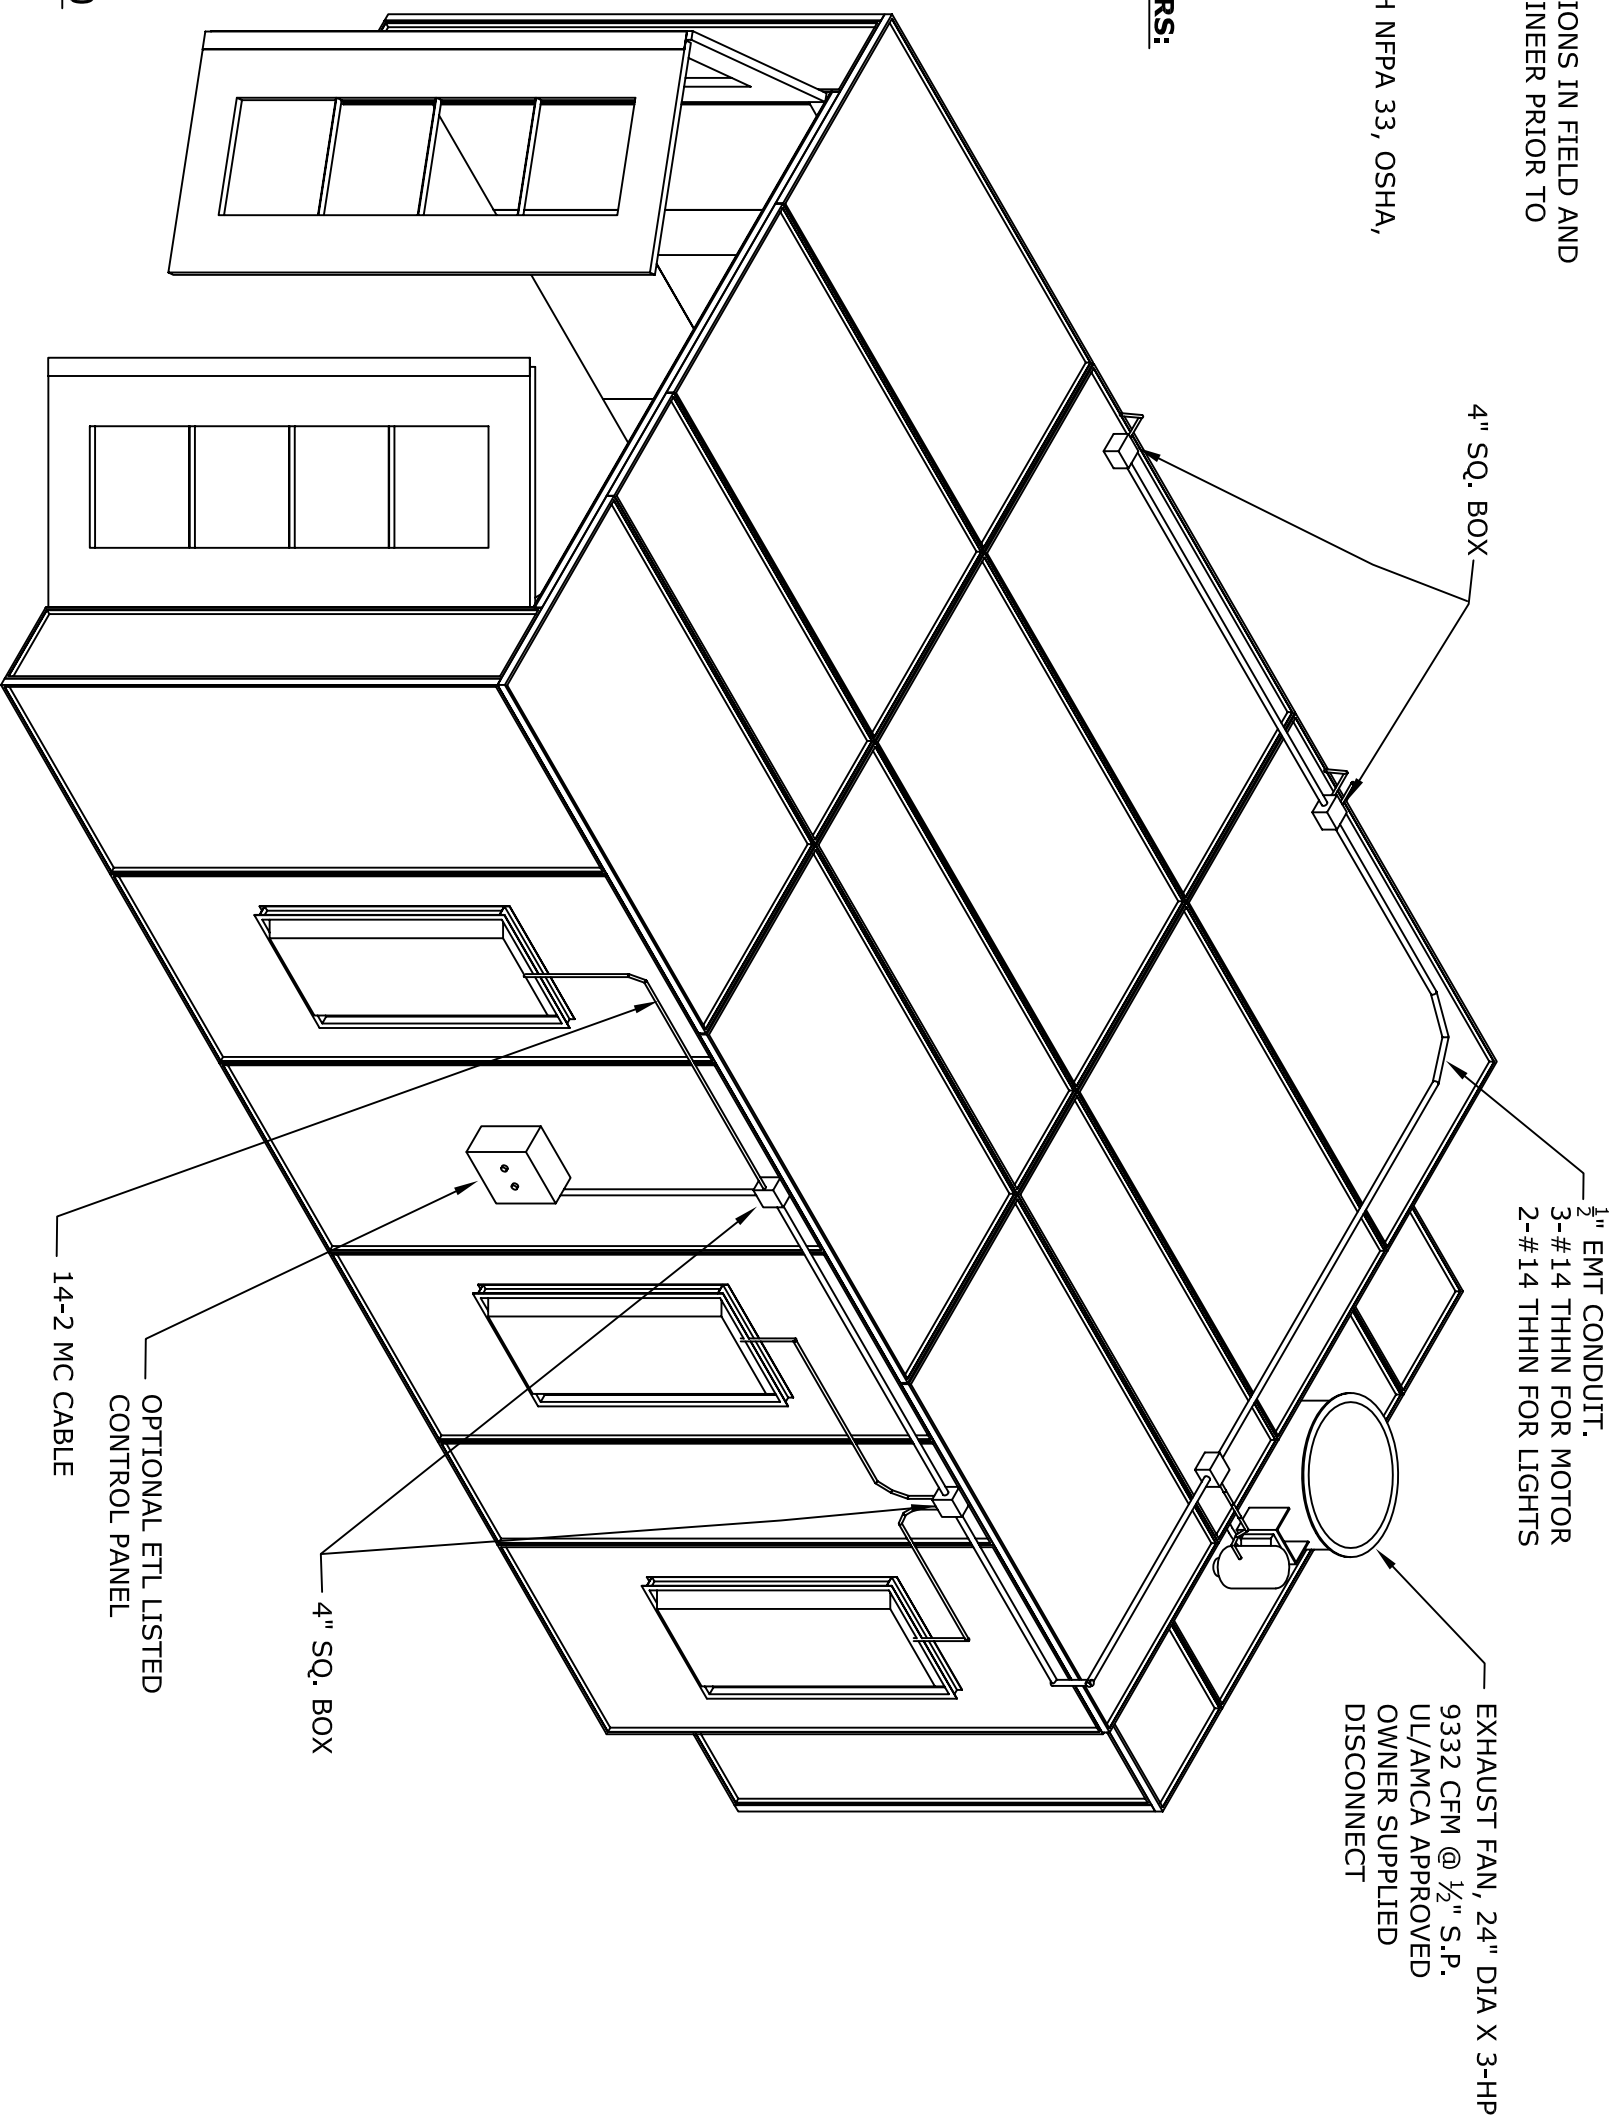

OPTIONAL ETL LISTED
 CONTROL PANEL

14-2 MC CABLE

MID-SIZE CROSS FLOW-1000

13'-0"W x 8'-6"H x 23'-4"L OUTSIDE
 12'-9"W x 8'-4"H x 20'-1"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.
- ALL ELECTRICAL MORE THAN 3'FROM ANY BOOTH OPENING

STANDARD TOOLS AND EQUIPMENT CO.
 Greensboro, NC 27405
 Ph - 1-800-451-2425

title MSCF-1000 ELECTRICAL RECOMMENDATION

part no MSCF-1000

order no -

drawn by J.DEHART

date 3-11-13

file name XXXX

rev A