


NOTE:
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND REPORT
 ANY DISCREPANCIES TO ENGINEER PRIOR TO STARTING WORK

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, AND
 NEC GUIDELINES

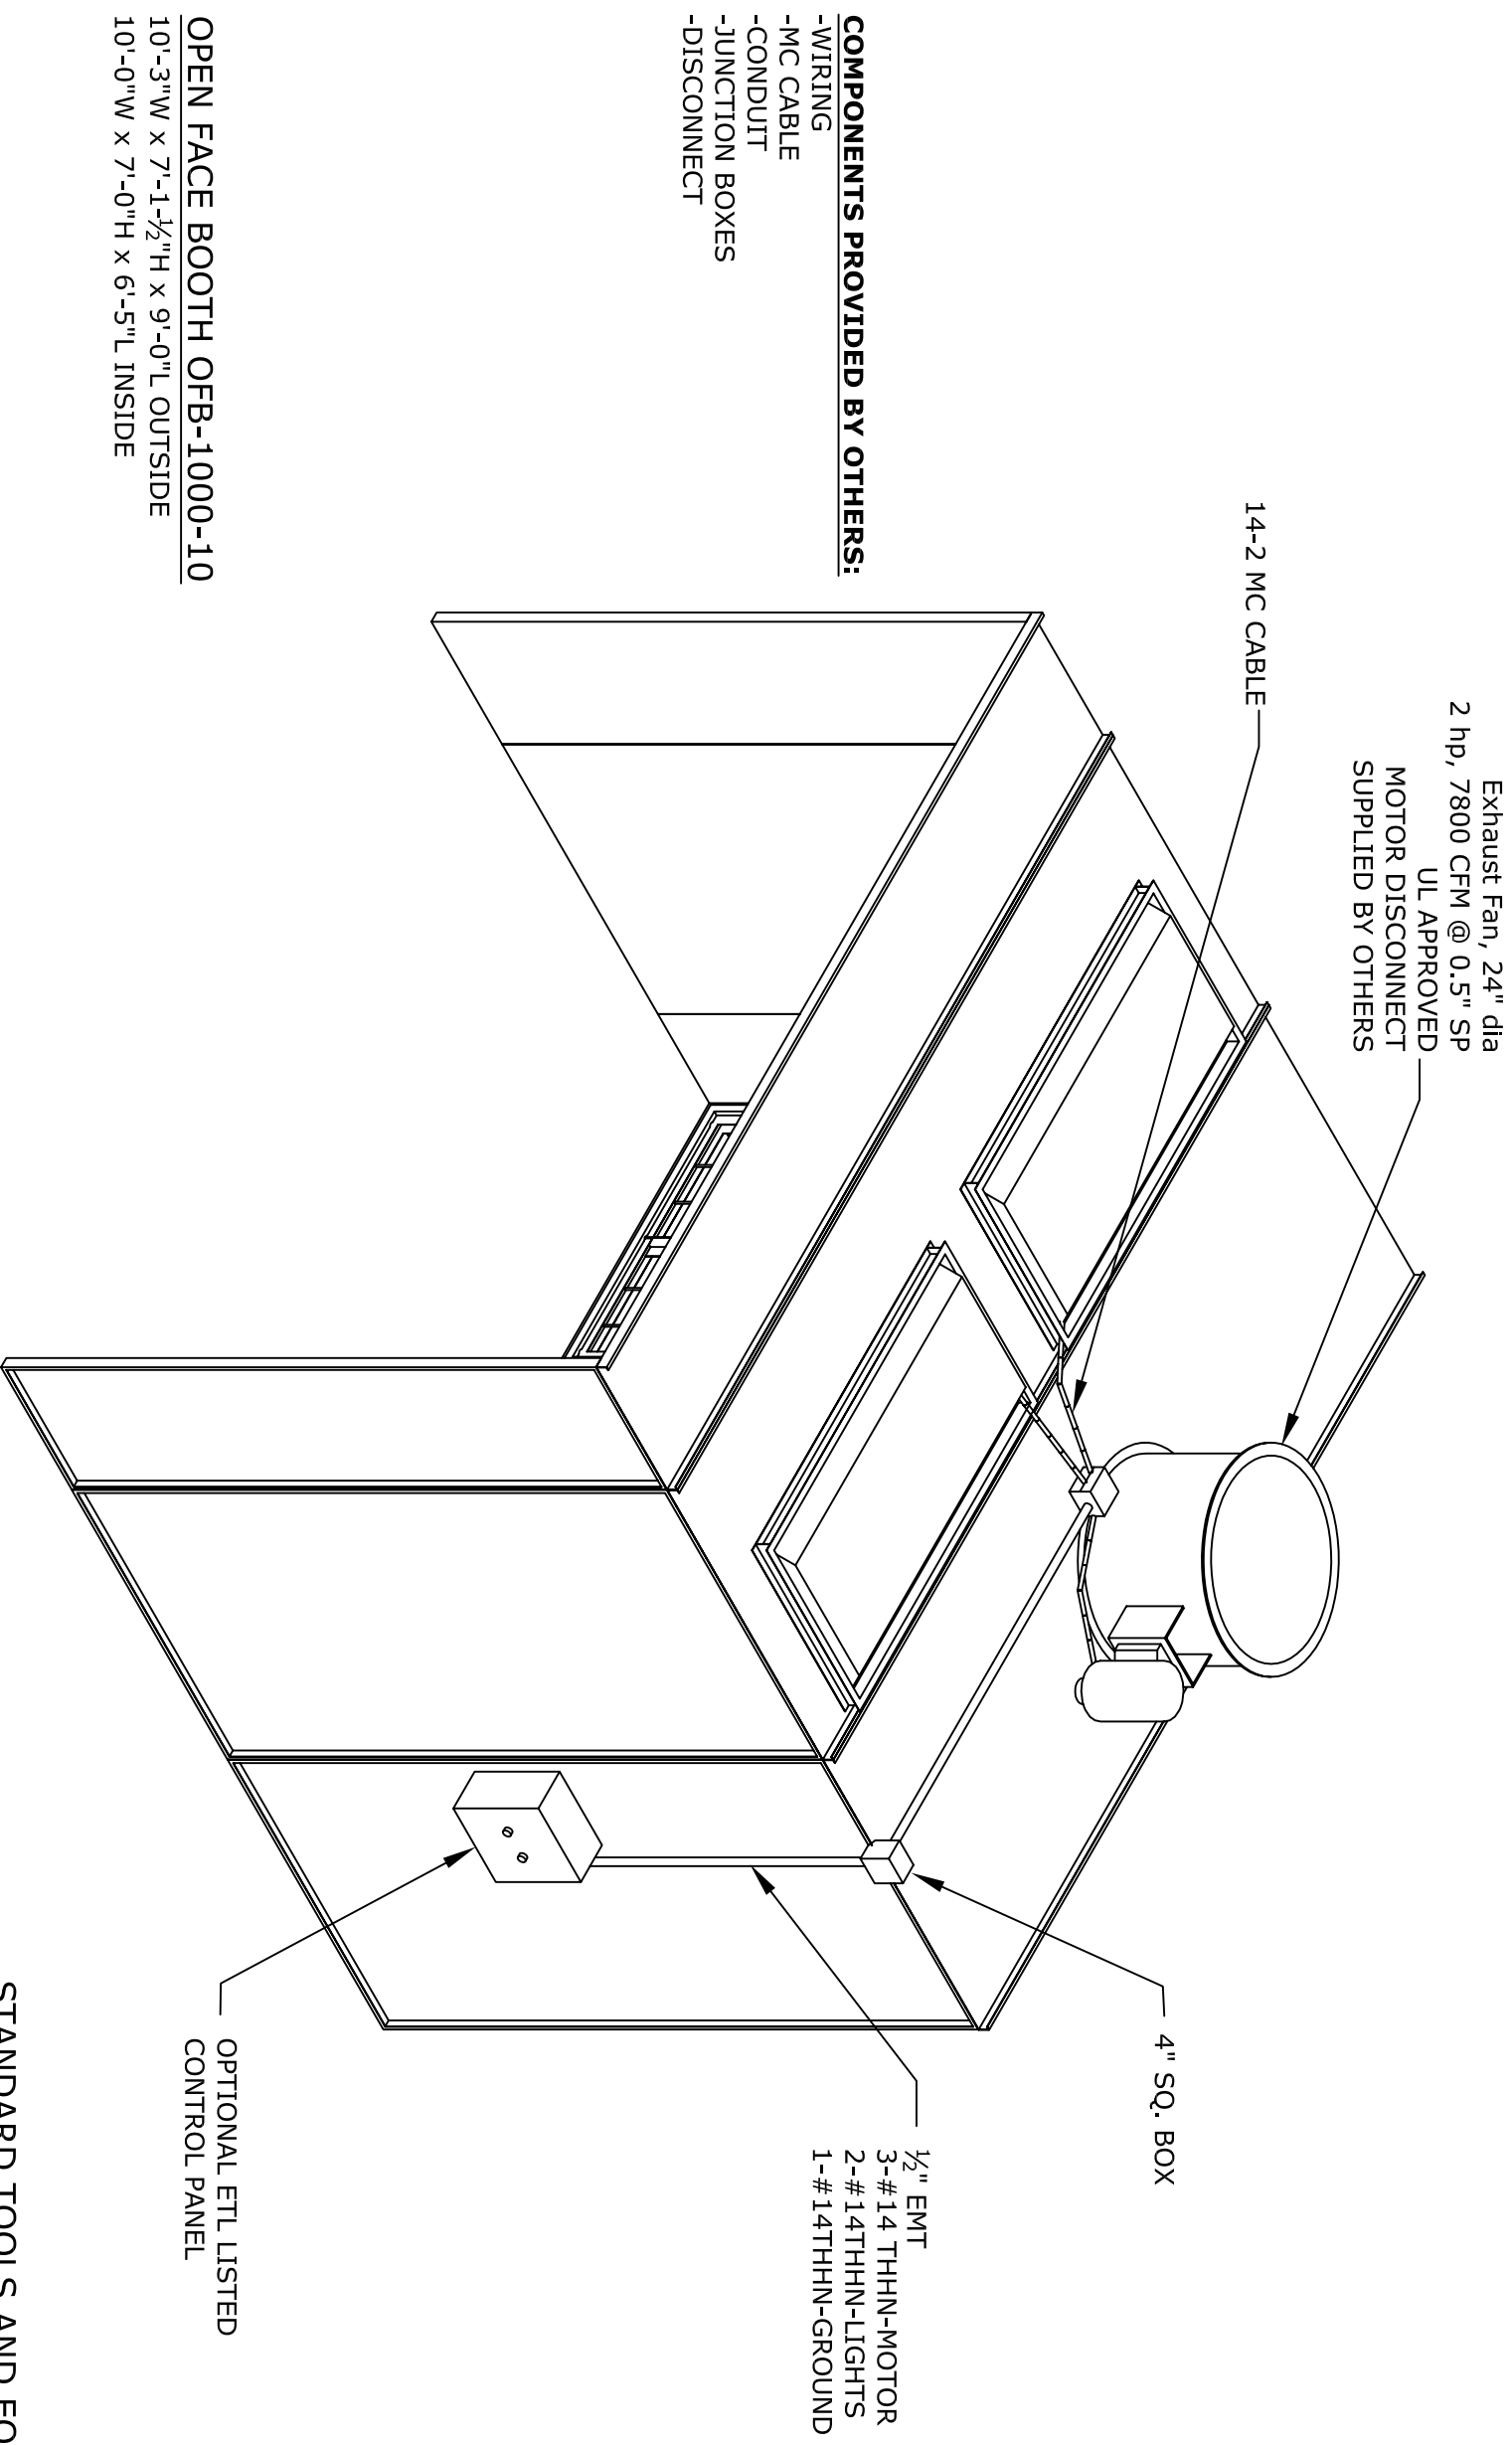

COMPONENTS PROVIDED BY OTHERS:

- WIRING
- MC CABLE
- CONDUIT
- JUNCTION BOXES
- DISCONNECT

OPEN FACE BOOTH OFB-1000-10

10'-3"W x 7'-1-1/2"H x 9'-0"L OUTSIDE
 10'-0"W x 7'-0"H x 6'-5"L INSIDE

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAVIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.
- ALL ELECTRICAL MORE THAN 3'FROM ANY BOOTH OPENING

STANDARD TOOLS AND EQUIPMENT CO.
 Greensboro, NC 27405
 Ph - 1-800-451-2425

title	OFB-1000-10-ELECTRICAL RECOMMENDATION		
part no	OFB-1000-10		
order no	-		
drawn by	J.DEHART	date	3-13-13
file name	XXXX	rev	A