


NOTE:
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND
 REPORT ANY DISCREPANCIES TO ENGINEER PRIOR TO
 STARTING WORK

EXHAUST FAN, 34" DIA
 3 HP, 13,965 CFM @ 0.5" SP
 UL APPROVED

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, AND
 NEC GUIDELINES

COMPONENTS PROVIDED BY OTHERS:

- WIRING
- MC CABLE
- CONDUIT
- JUNCTION BOXES
- DISCONNECT

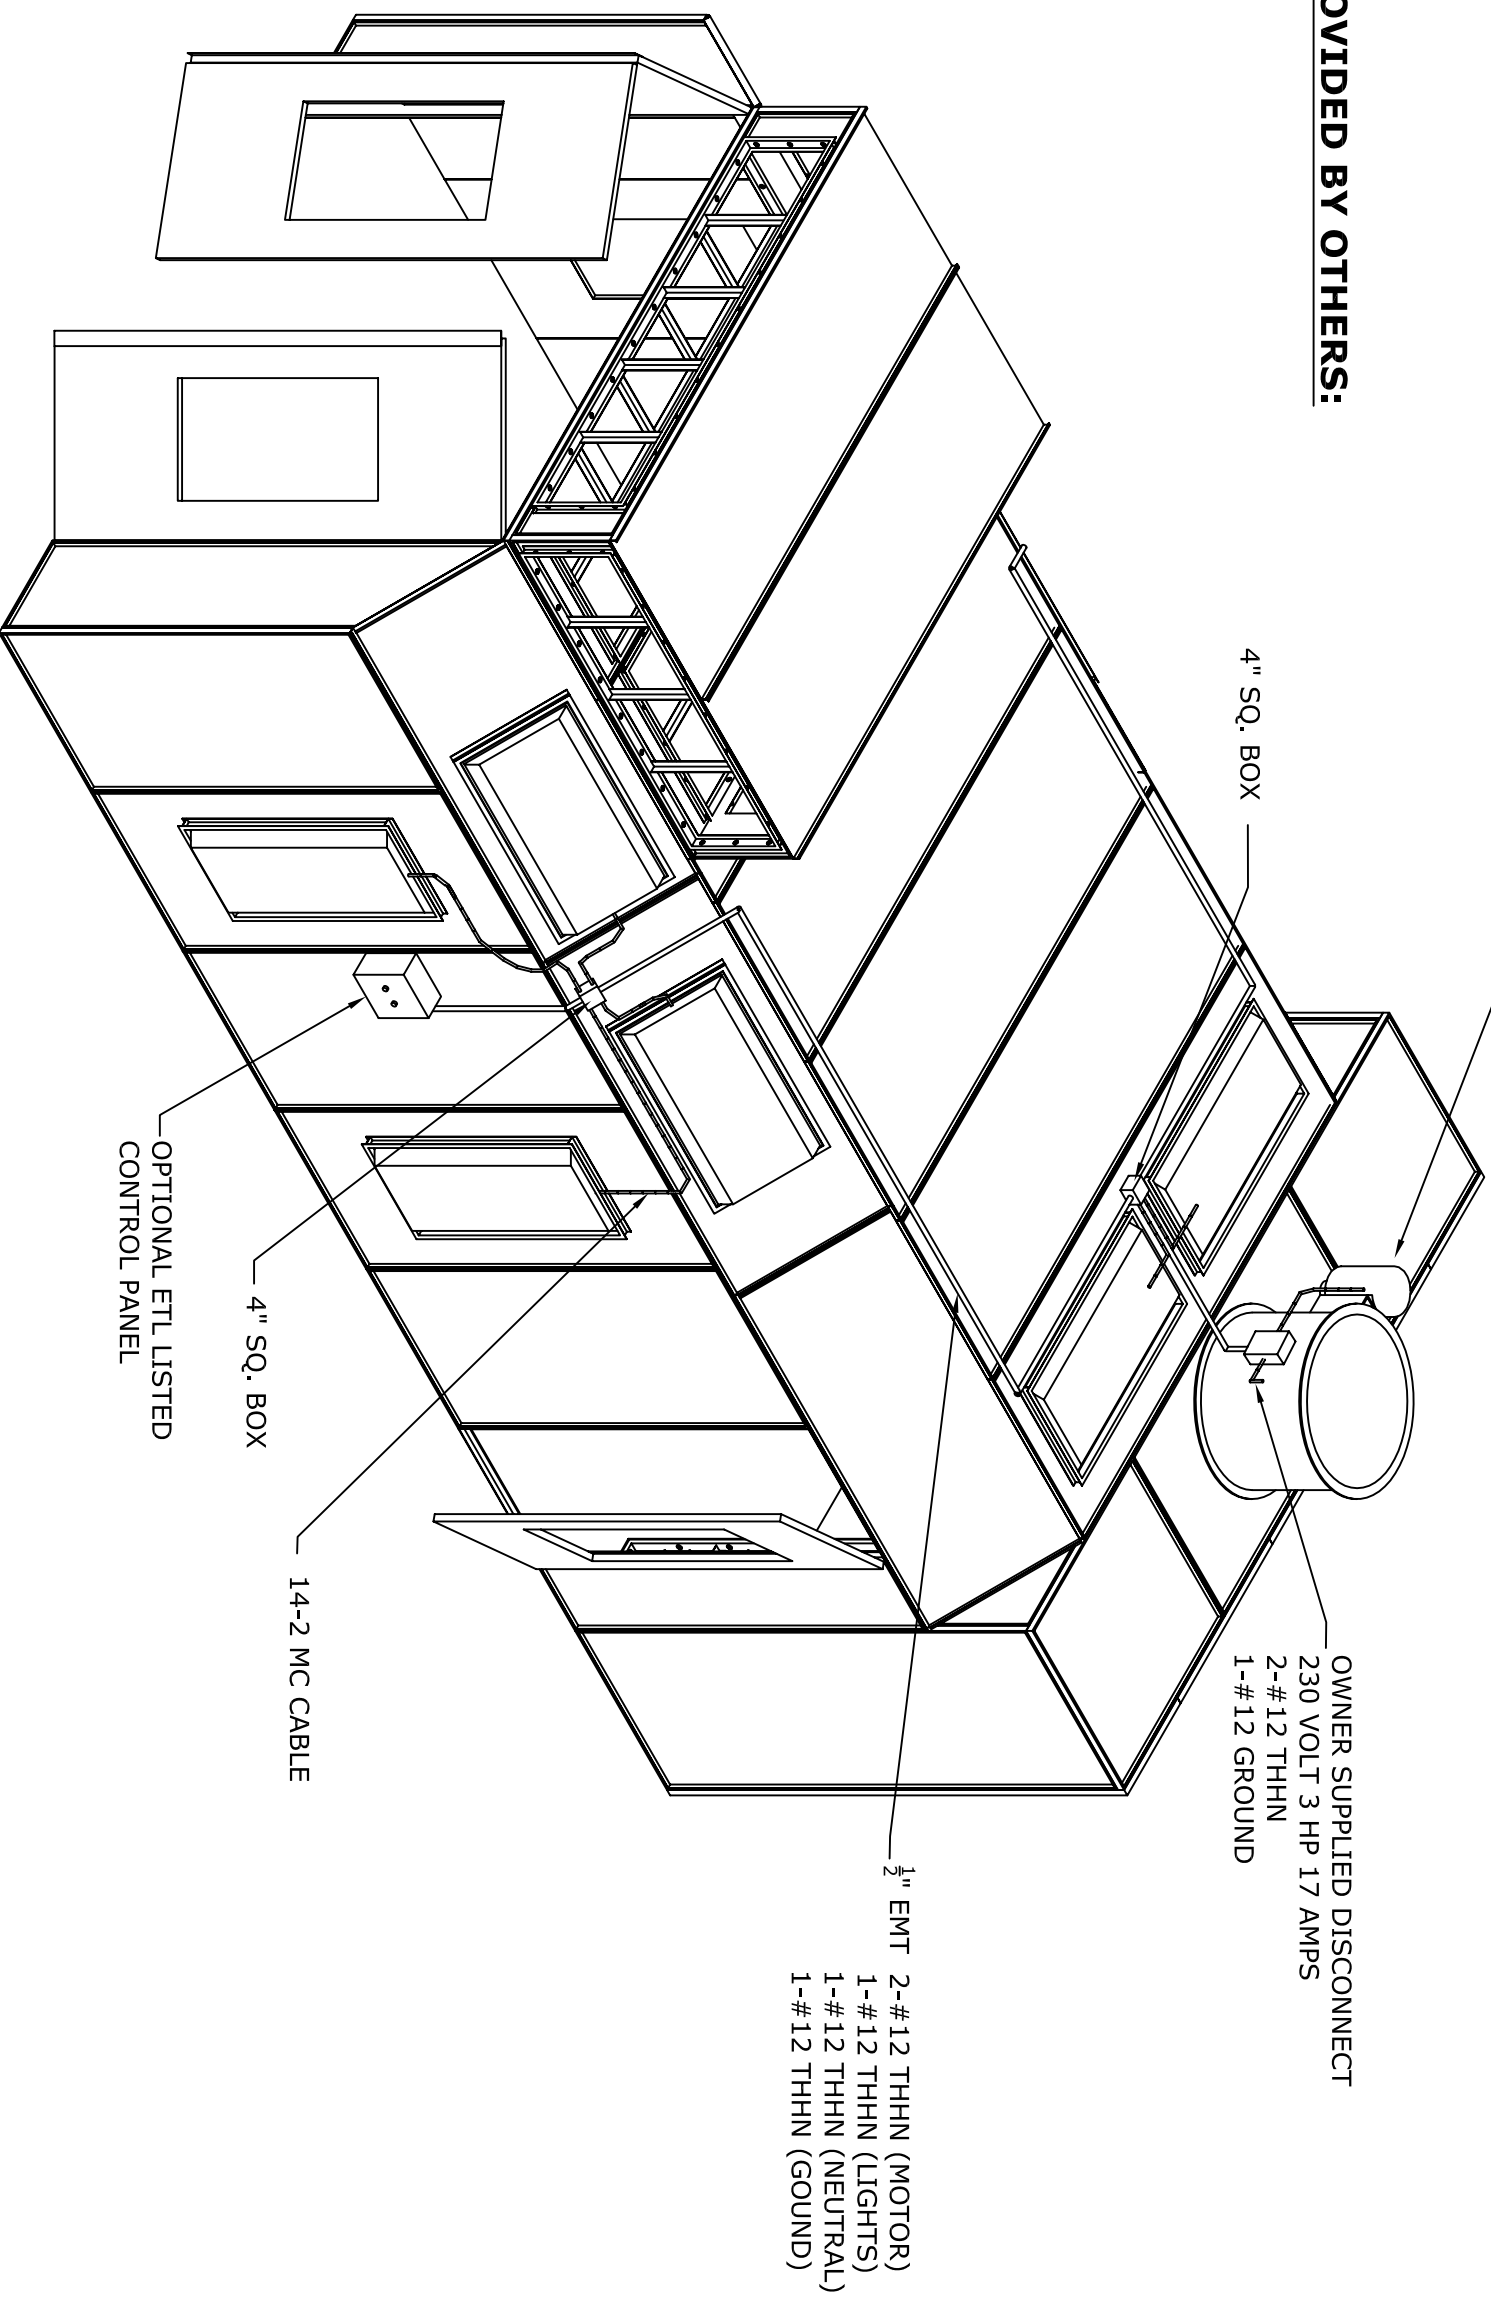

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEAXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.
- ALL ELECTRICAL GREATER THAN 3' FROM ANY BOOTH OPENING

STANDARD TOOLS AND EQUIPMENT CO.

Greensboro, NC 27405

Ph - 1-800-451-2425

title SD-1000-ELECTRICAL RECOMMENDATION

part no SD-1000

order no -

drawn by J.DEHART

date 3-5-13

file name XXXX

rev A