


NOTE:
 CONTRACTOR TO VERIFY ALL DIMENSIONS IN FIELD AND REPORT
 ANY DISCREPANCIES TO ENGINEER PRIOR TO STARTING WORK

MANUFACTURED IN COMPLIANCE WITH NFPA 33, OSHA, AND
 NEC GUIDELINES

TRUCK CROSS FLOW-1000
 17'-0"W x 16'-8"H x 40'-0"L OUTSIDE
 16'-0"W x 16'-2"H x 37'-5"L INSIDE

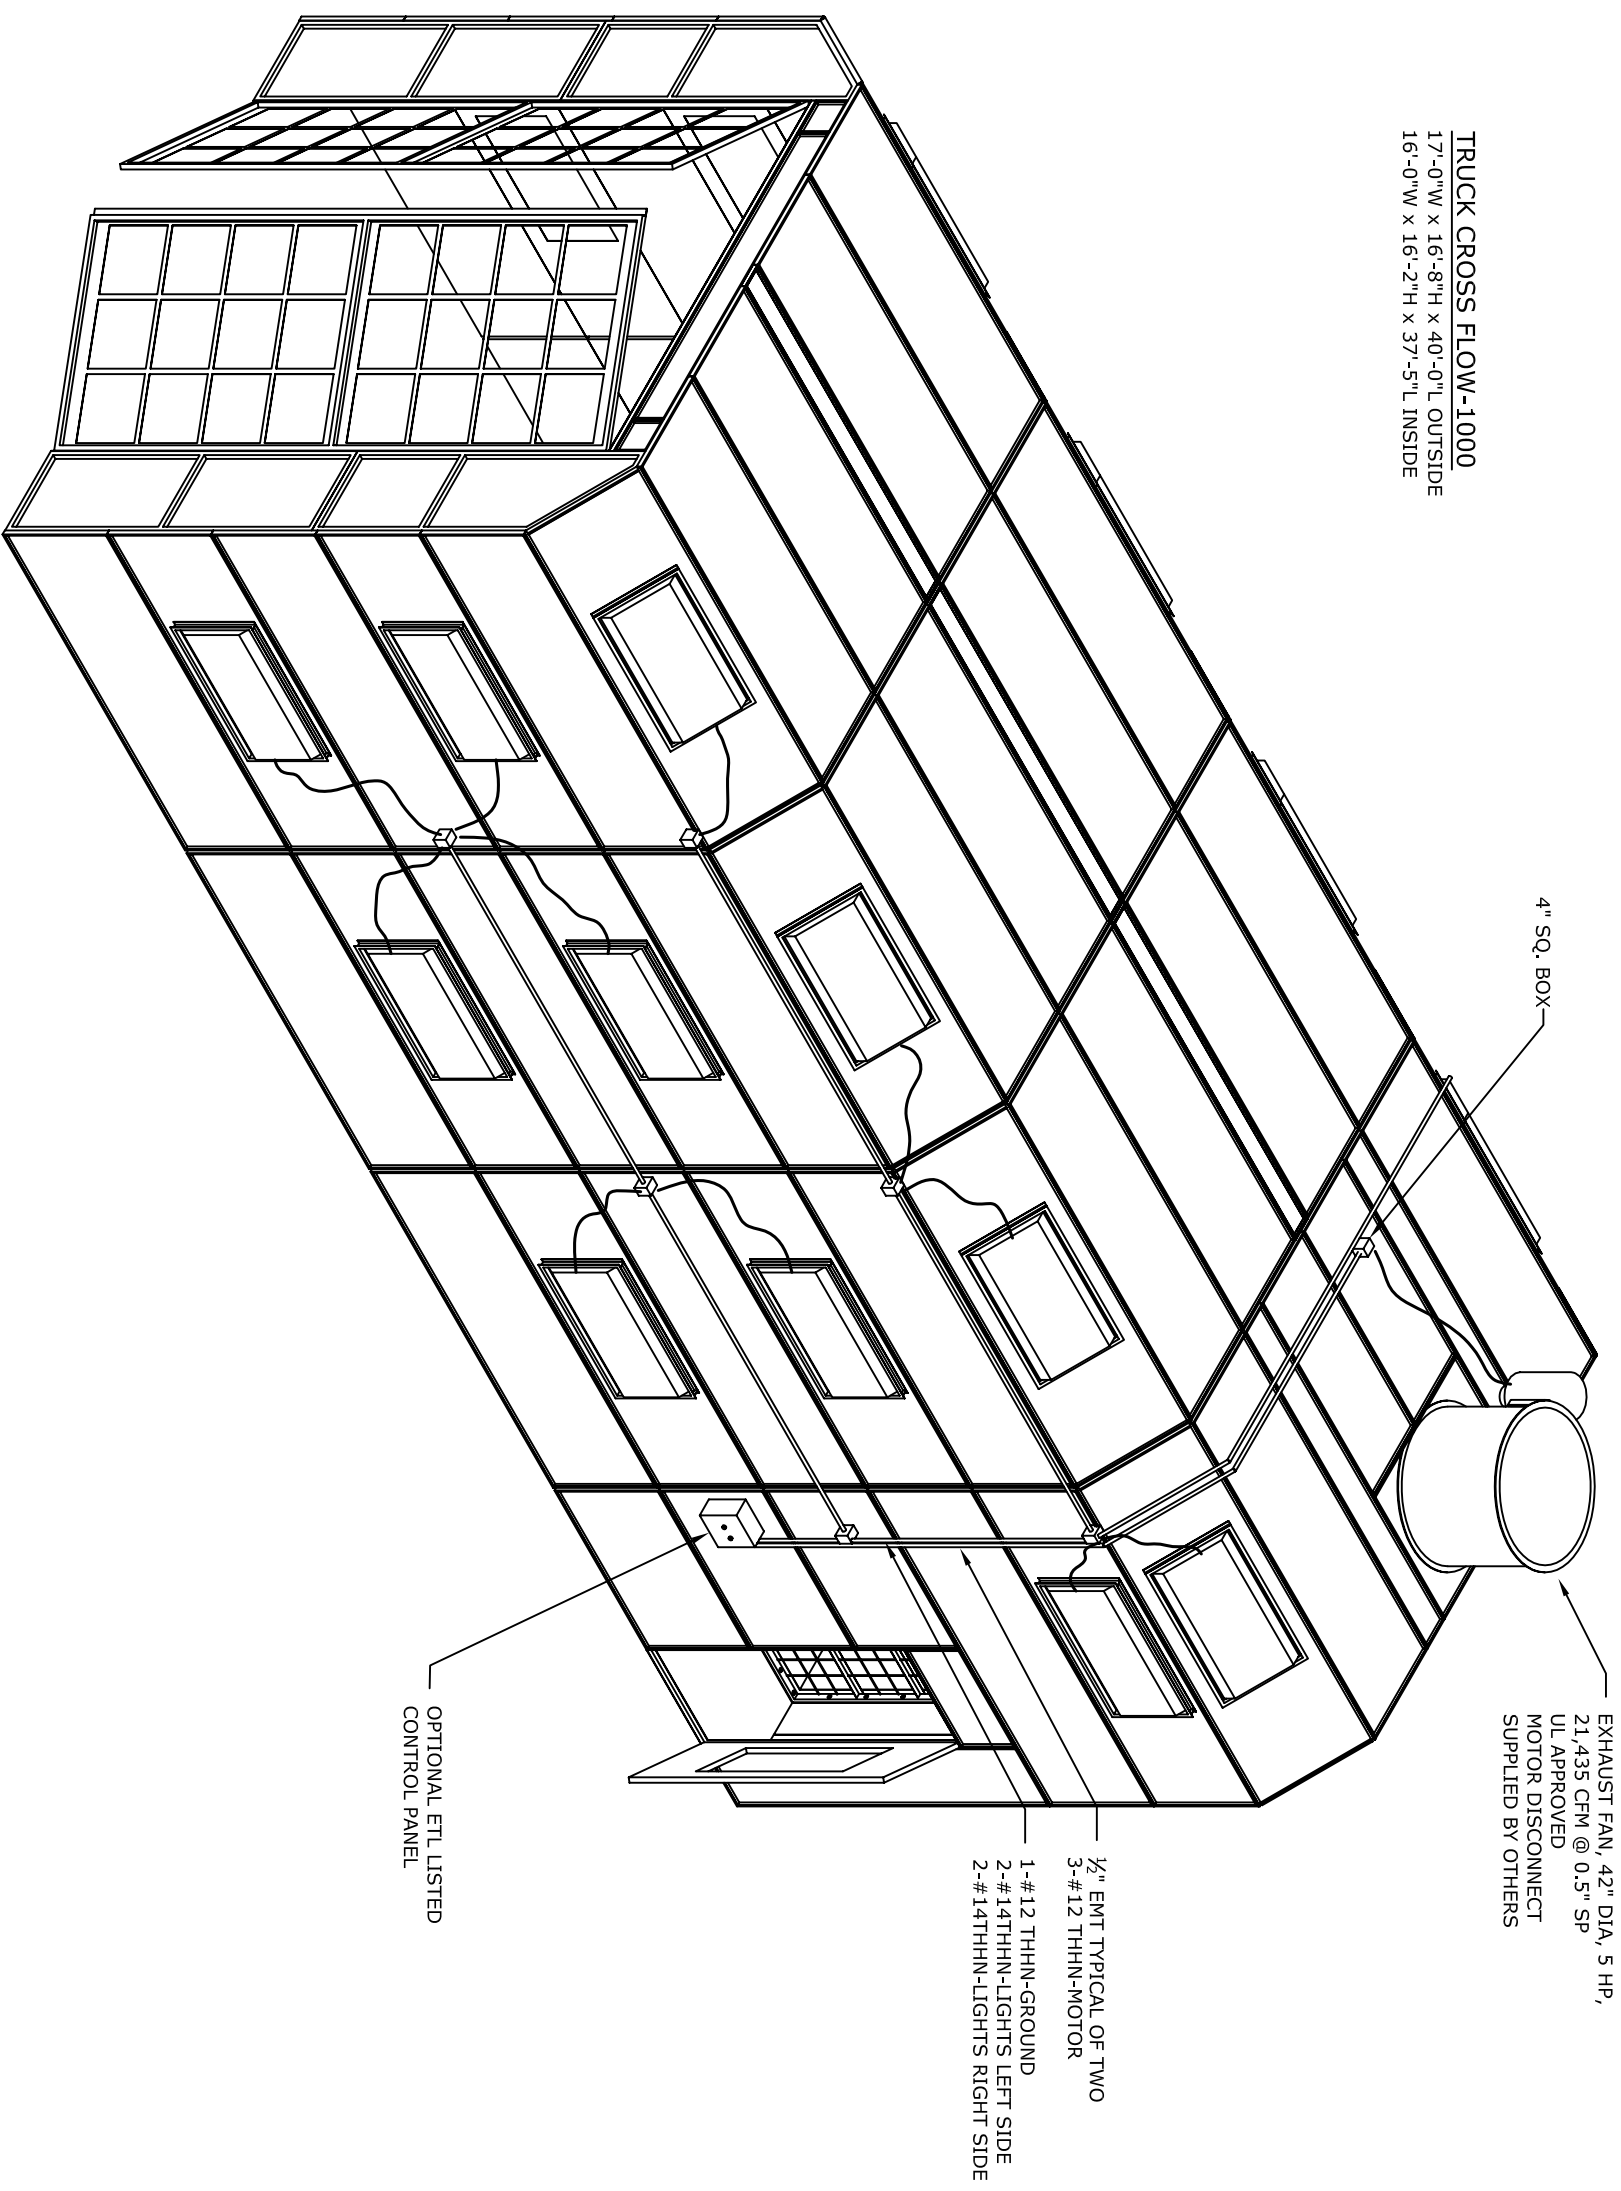

4" SQ. BOX

EXHAUST FAN, 42" DIA, 5 HP,
 21,435 CFM @ 0.5" Sp
 UL APPROVED
 MOTOR DISCONNECT
 SUPPLIED BY OTHERS

1/2" EMT TYPICAL OF TWO
 3-#12 THHN-MOTOR
 1-#12 THHN-GROUND
 2-#14THHN-LIGHTS LEFT SIDE
 2-#14THHN-LIGHTS RIGHT SIDE

OPTIONAL ETL LISTED
 CONTROL PANEL

- COMPONENTS PROVIDED BY OTHERS:**
- WIRING
 - MC CABLE
 - CONDUIT
 - JUNCTION BOXES
 - DISCONNECT

NOTES:

- ALL MATERIALS OF CONSTRUCTION ARE NON-COMBUSTIBLE.
- ALL PANELS ARE 18 GA. GALV SHEET STEEL.
- WINDOWS ARE 1/4" TEMPERED GLASS.
- LIGHT FIXTURES ARE ENCLOSED 2x4 FLORESCENT LAYIN TYPE, UL APPROVED, MOUNTED BEHIND GLASS WINDOW.
- FAN IS TUBEXIAL, ALUMINUM BLADE WITH DRIVE BELT IN ENCLOSED SHROUD, UL APPROVED.
- ALL ELECTRICAL MORE THAN 3'FROM ANY BOOTH OPENING
- REQUIRES TWO LIGHT CIRCUITS 15 AMP MINIMUM EACH
- LIGHT CIRCUITS TYPICAL BOTH SIDES

STANDARD TOOLS AND EQUIPMENT CO.

Greensboro, NC 27405
 Ph - 1-800-451-2425

title	STCF-100040 ELECTRICAL RECOMMENDATION
part no	STCF-1000
order no	-
drawn by	J.DEHART
date	3-13-13
file name	XXXX
rev	A